

Rinnai®

EXPERIENCE OUR INNOVATION™

Boiler Applications Drawings




800000026 Rev A


06//2010

Contents


Drawing No.	Boiler Model	Description	
EPD-09-0001	E Series Boiler	DHW Piping Thermostatic Valve	3
EPA-09-0001	E Series Boiler	Single Zone.....	4
QPD-09-0001	Q175C Boiler	DHW Recirculation	5
QPD-09-0002	Q Series Boiler	DHW from Indirect Tank	6
QPD-09-0003	Q Series Boiler	Single Zone Priority DHW.....	7
QPD-09-0004	Q Series Boiler	4 Zone Valve with DHW	8
QPA-09-0001	Q Series Boiler	3 On-Off High Temperature Zones.....	9
QPA-09-0002	Q Series Boiler	3 Way Thermostatic Mixing	10
QPA-09-0003	Q Series Boiler	3 Way Motorized Mixing	11
QPA-09-0004	Q Series Boiler	3 Zone Valve.....	12
QPA-09-0005	Q Series Boiler	Direct Coupled Radiant	13
QPA-09-0006	Q Series Boiler	Single Zone Split Loop	14
QPA-09-0007	Q Series Boiler	Snow Melt System.....	15
QPA-09-0008	Q Series Boiler	3 Zone Pumps	16
QPA-09-0009	Q & E Series Boilers ...	Condensate Plumbing with and without Neutralizer	17
QPC-09-0001	Q Series Boilers	2 Boiler Install	18
QPC-09-0002	Q Series Boilers	3 Boiler Install	19
QPC-09-0003	Q Series Boilers	2 Boilers with DHW.....	20
QEC-09-0001	Q Series Boilers	2 Boilers with DHW Indirect Tank.....	21
QED-09-0001	Q Series Boilers	Single Zone Circuit with Priority DHW	22
QED-09-0002	Q Series Boilers	4 Zone Valves with Priority DHW	23
LEGEND.....	Q & E Series Boilers ...	Legend.....	24

Rinnai is continually updating and improving products; therefore, drawings and specifications are subject to change without prior notice. Local, state, provincial and federal codes must be adhered to prior to installation.

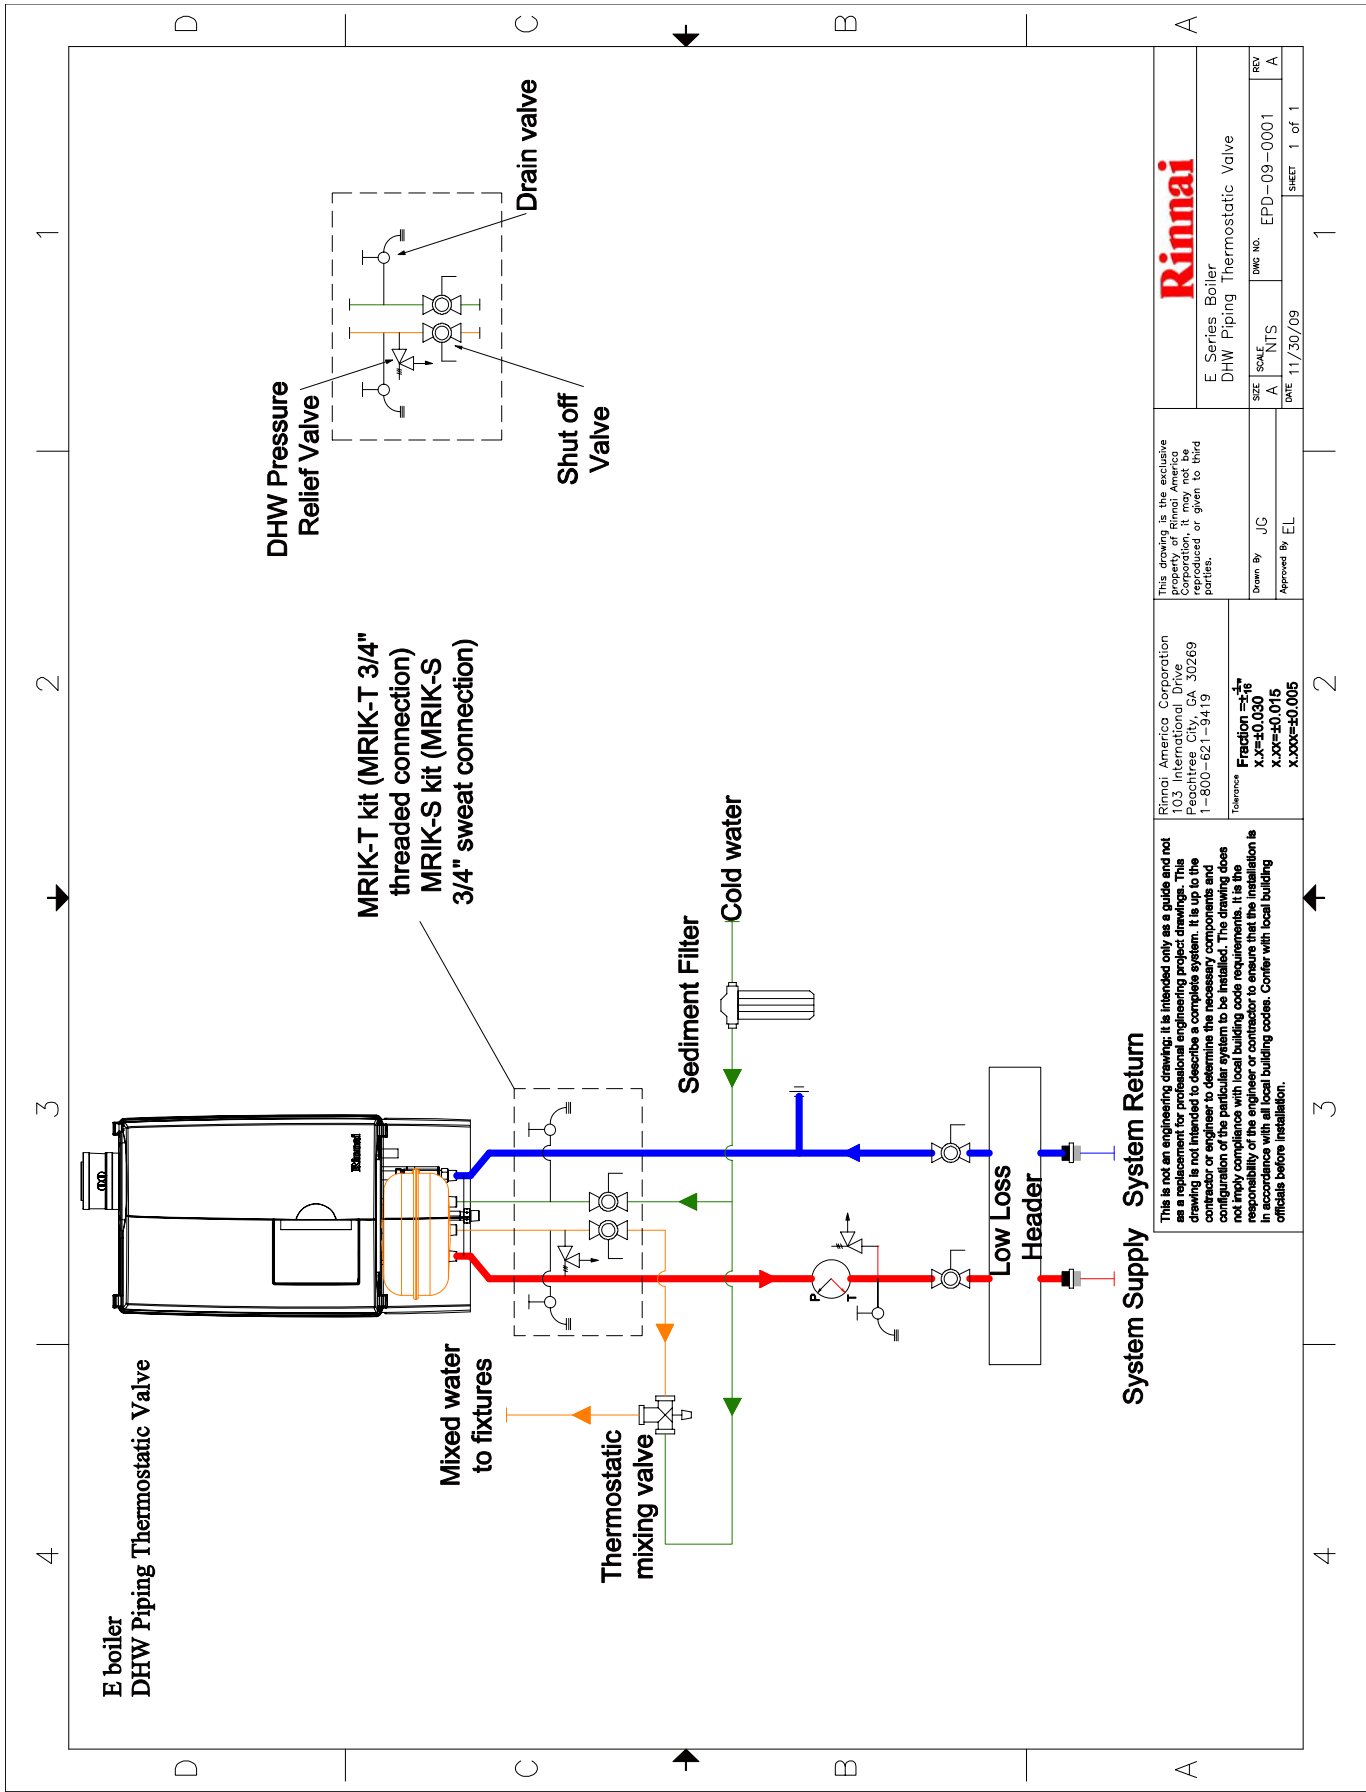


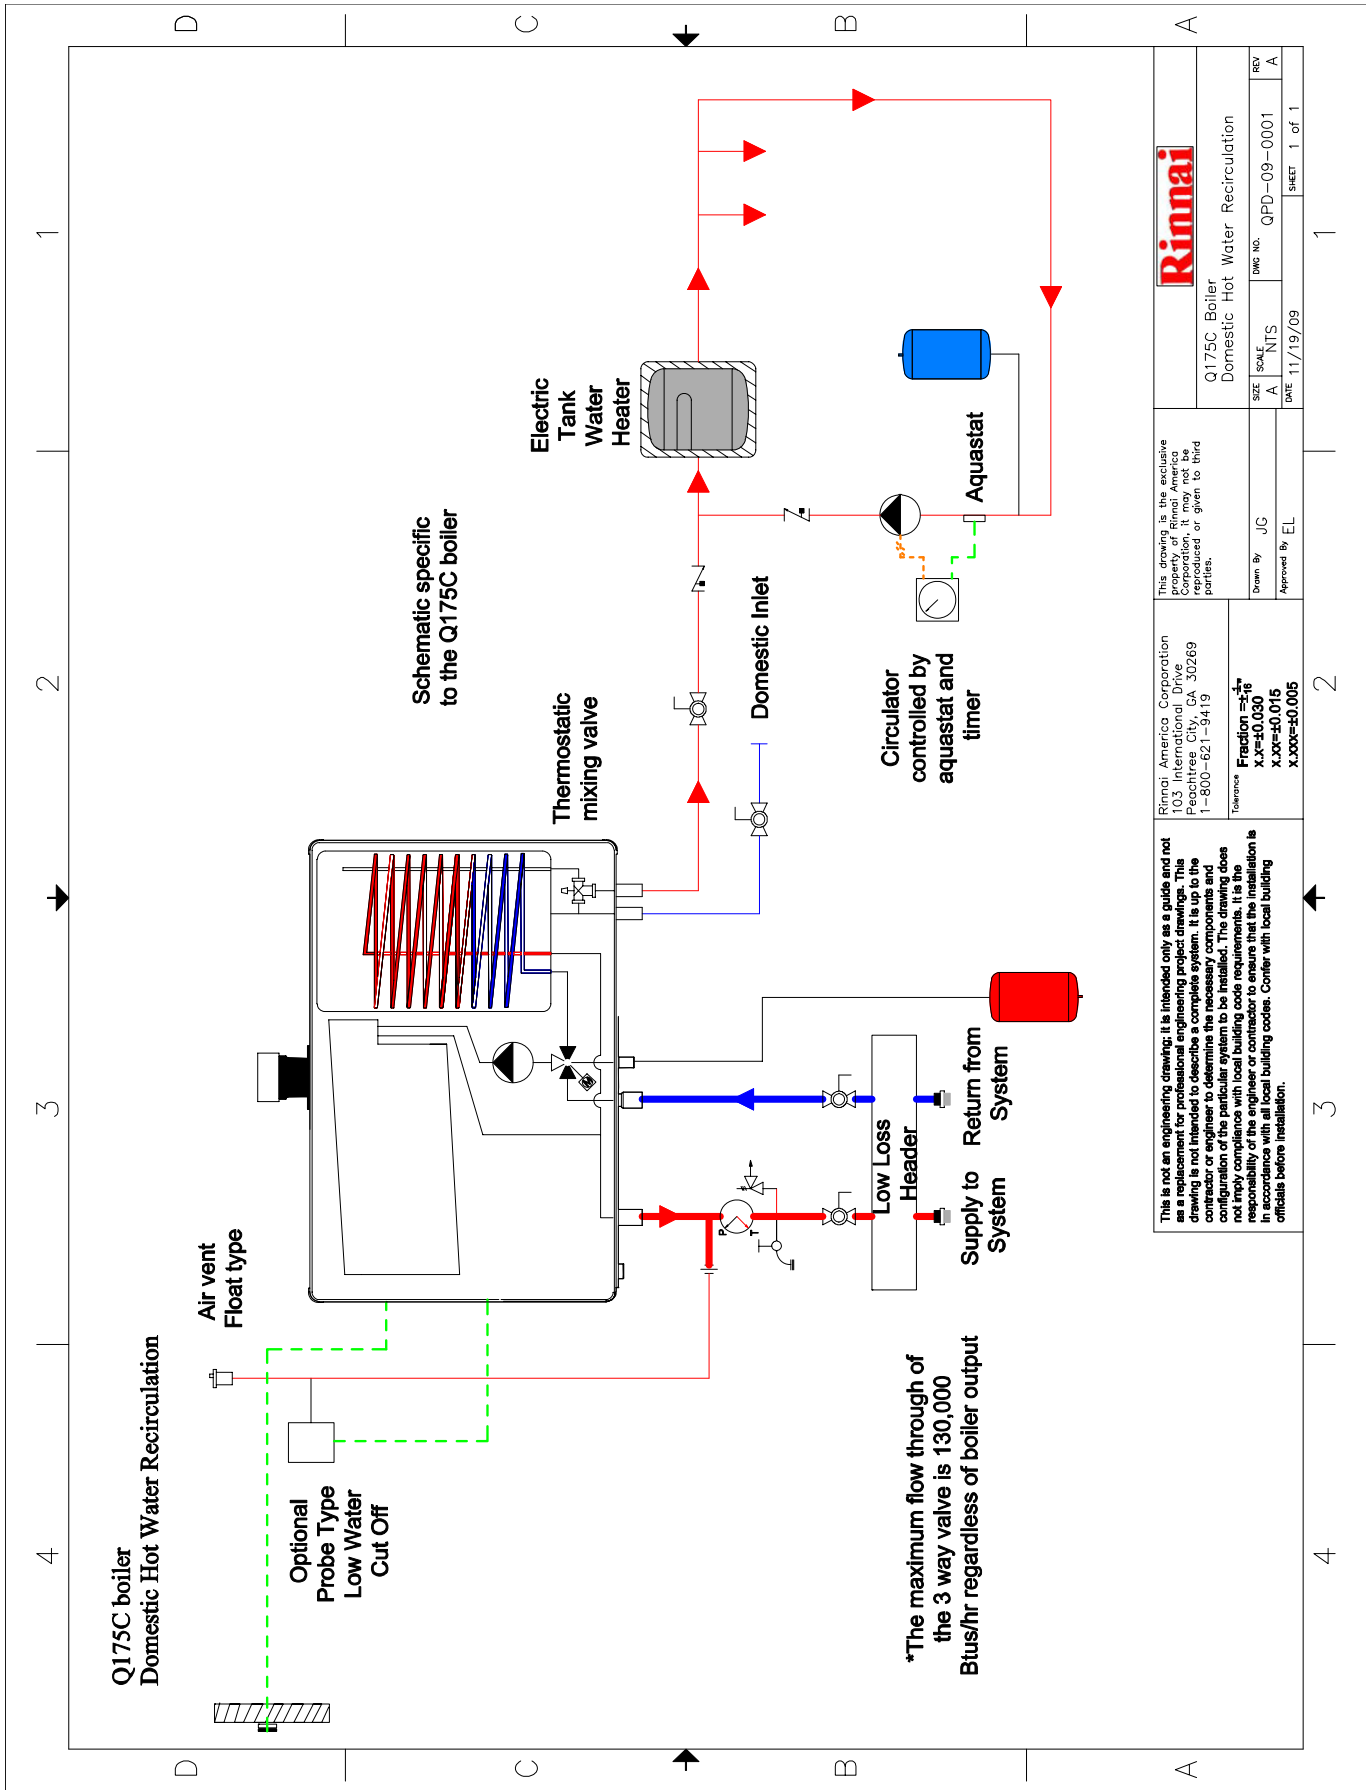



<p>This is not an engineering drawing. It is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.</p>		<p>This drawing is the exclusive property of Rinnai America Corporation. It is not to be reproduced or given to third parties.</p>	
<p>Rinnai America Corporation 103 International Drive Peachtree City, GA 30269 1-800-621-9419</p>		<p>Rinnai</p>	
<p>Tolerance Fraction $\pm \frac{1}{16}$ X.X ± 0.030 X.XX ± 0.015 X.XXX ± 0.005</p>		<p>Q175C Boiler Domestic Hot Water Recirculation</p>	
<p>Drawn By JG Approved By EL</p>		<p>SIZE SCALE A NTS DATE 11/19/09</p>	
<p>DWG NO. QPD-09-0001</p>		<p>REV A</p>	
<p>SHEET 1 of 1</p>		<p>1</p>	

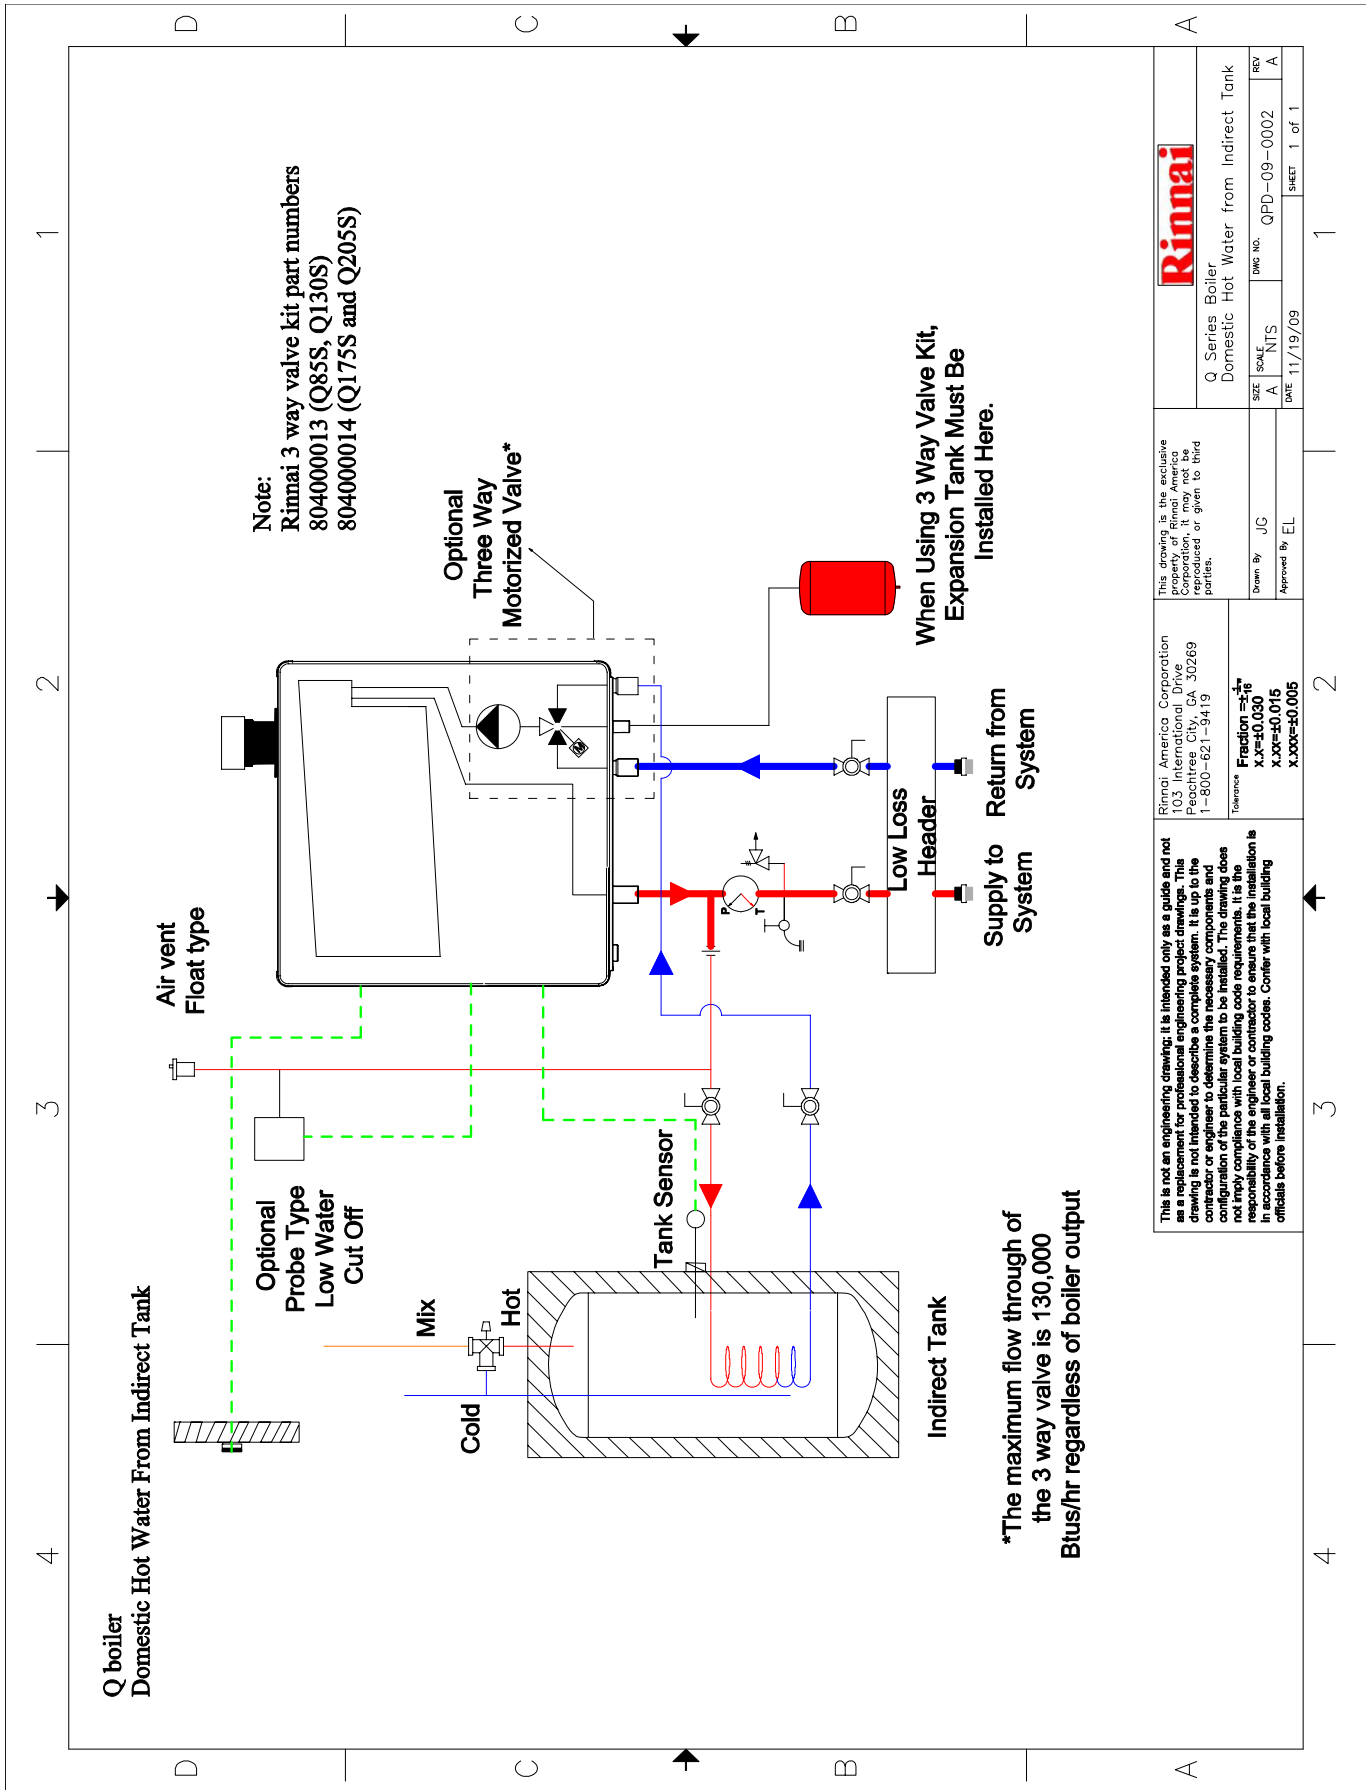



<p>This is not an engineering drawing. It is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.</p>		<p>Rinnai America Corporation 103 International Drive Peachtree City, GA 30269 1-800-621-9419</p>		<p>This drawing is the exclusive property of Rinnai America Corporation. It is not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Rinnai America Corporation.</p>	
<p>Tolerance Fraction $\pm \frac{1}{16}$ X.XX ± 0.030 X.XXX ± 0.015 X.XXXX ± 0.005</p>		<p>Drawn By JG Approved By EL</p>		<p>Q Series Boiler Domestic Hot Water from Indirect Tank</p>	
<p>DATE 11/19/09</p>		<p>SIZE SCALE A NTS</p>		<p>DWG NO. QPD-09-0002</p>	
<p>SHEET 1 of 1</p>		<p>REV A</p>		<p>Rinnai</p>	

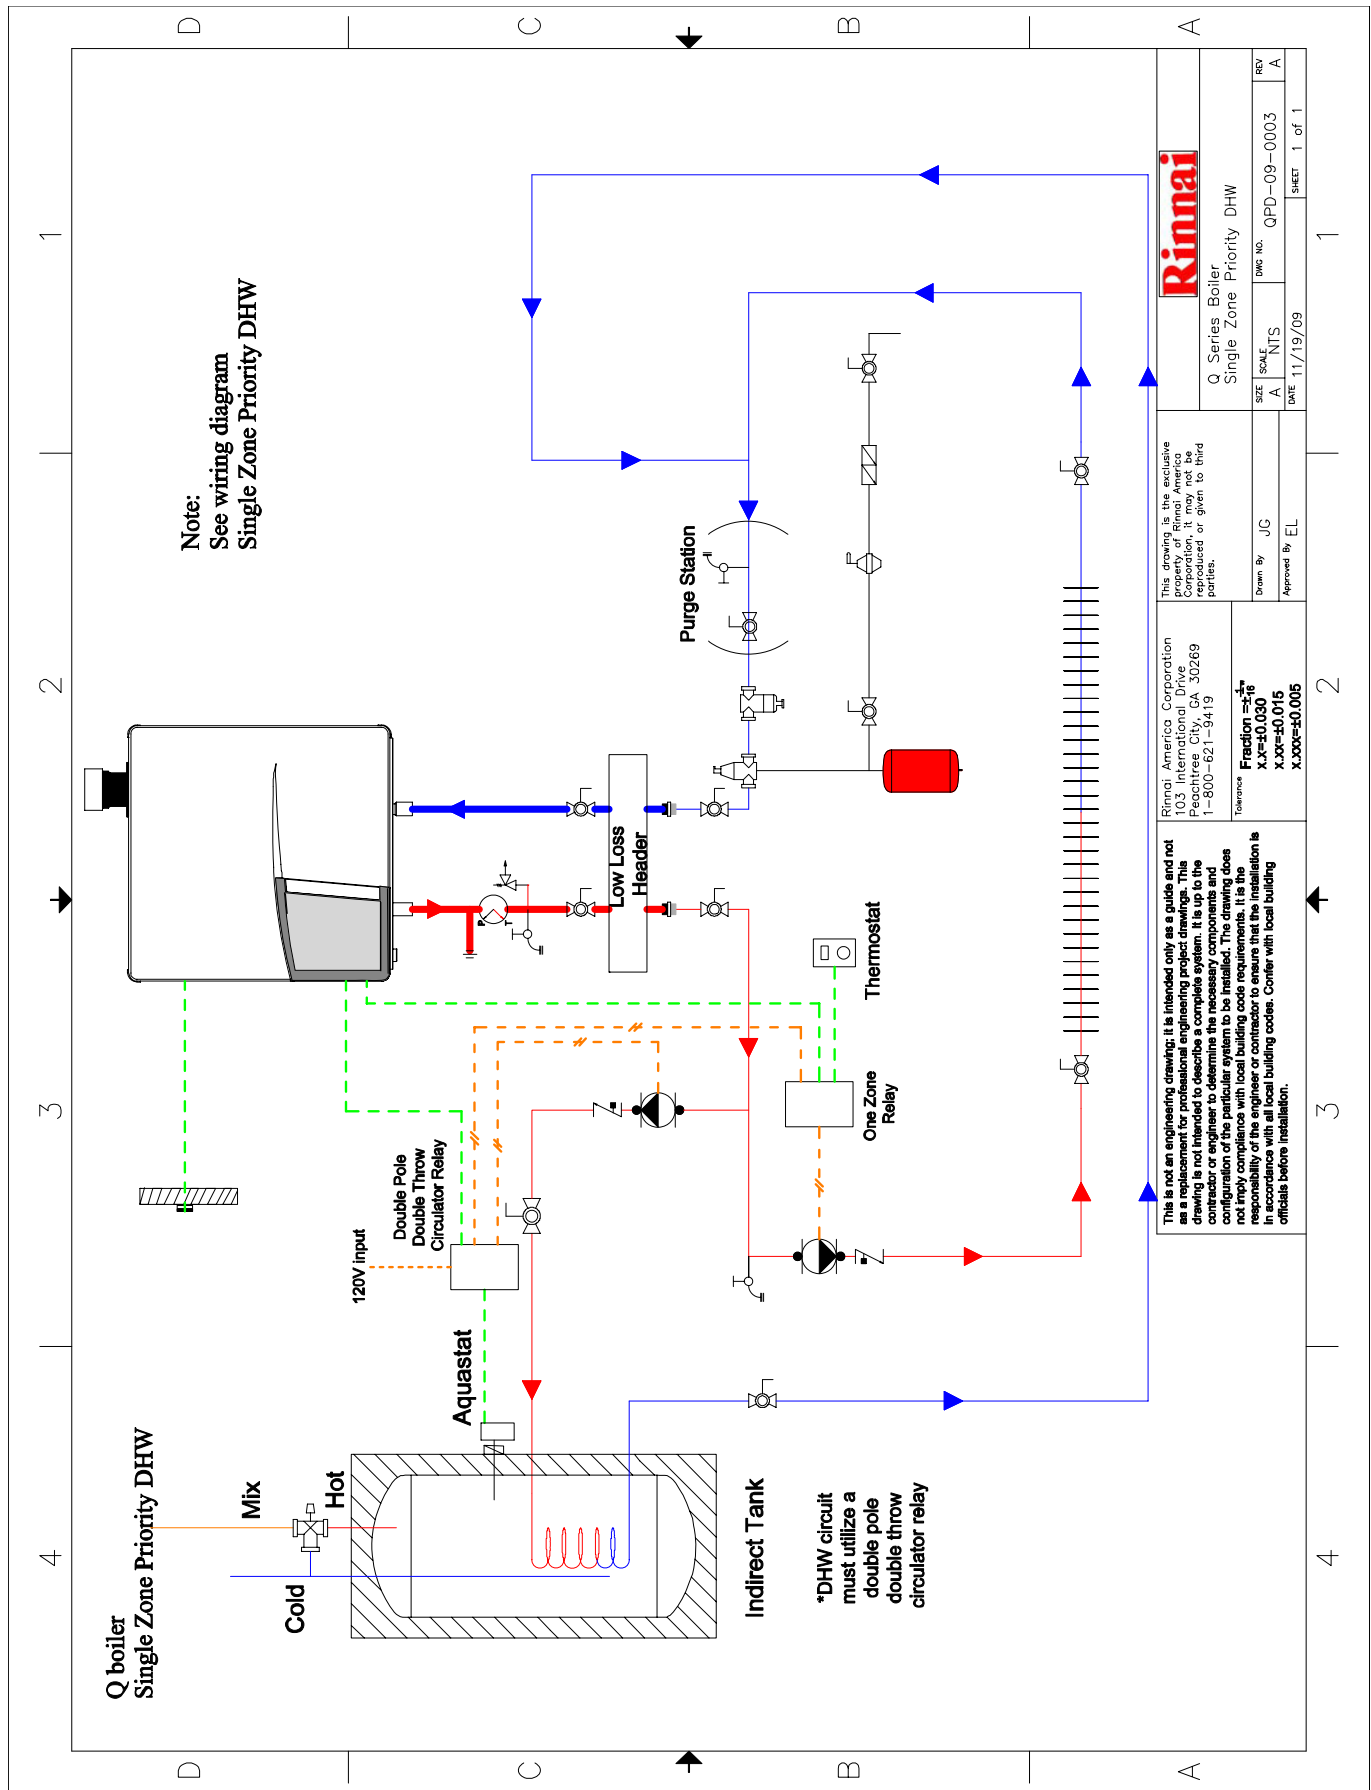


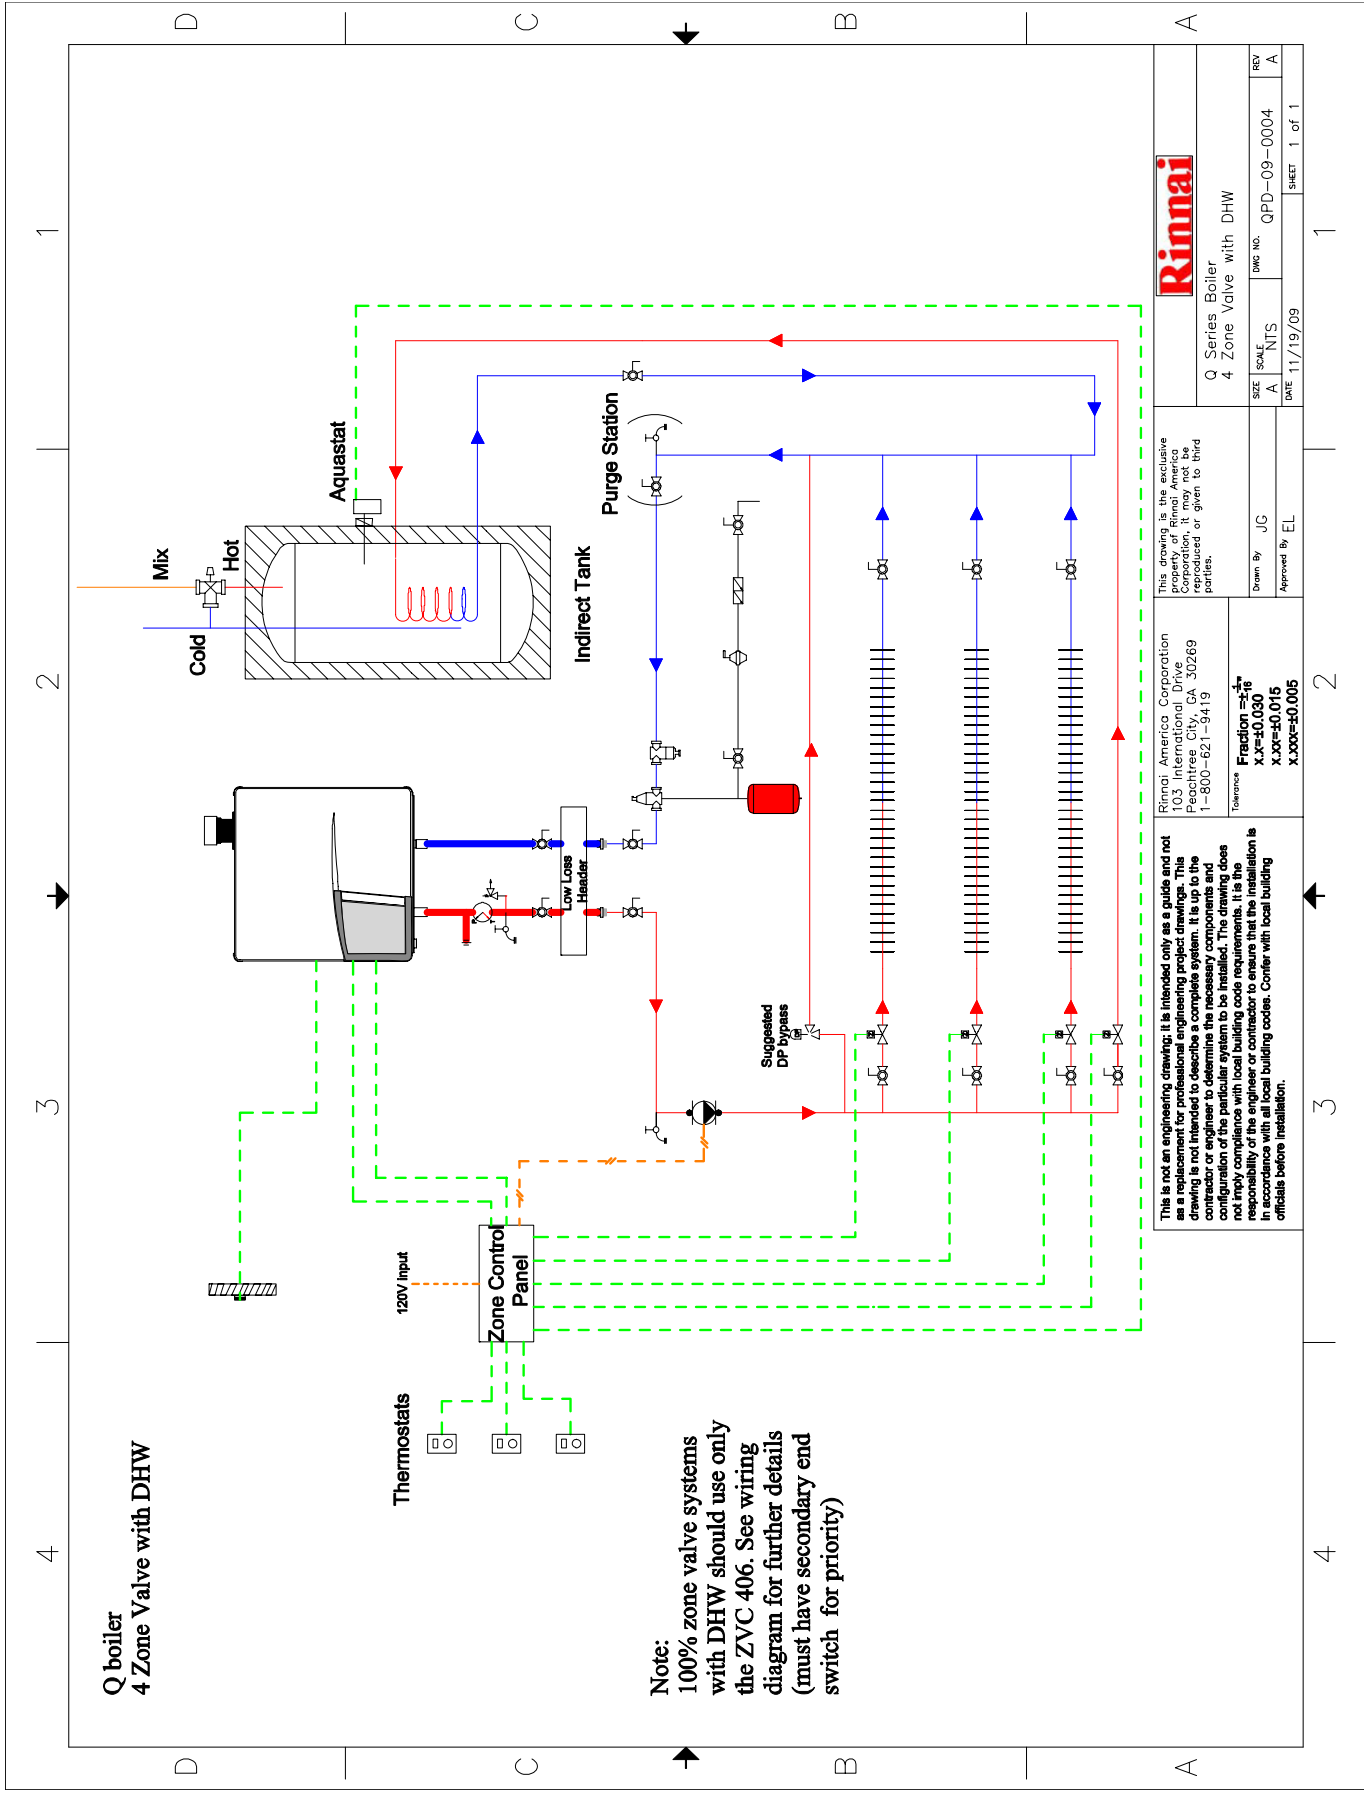

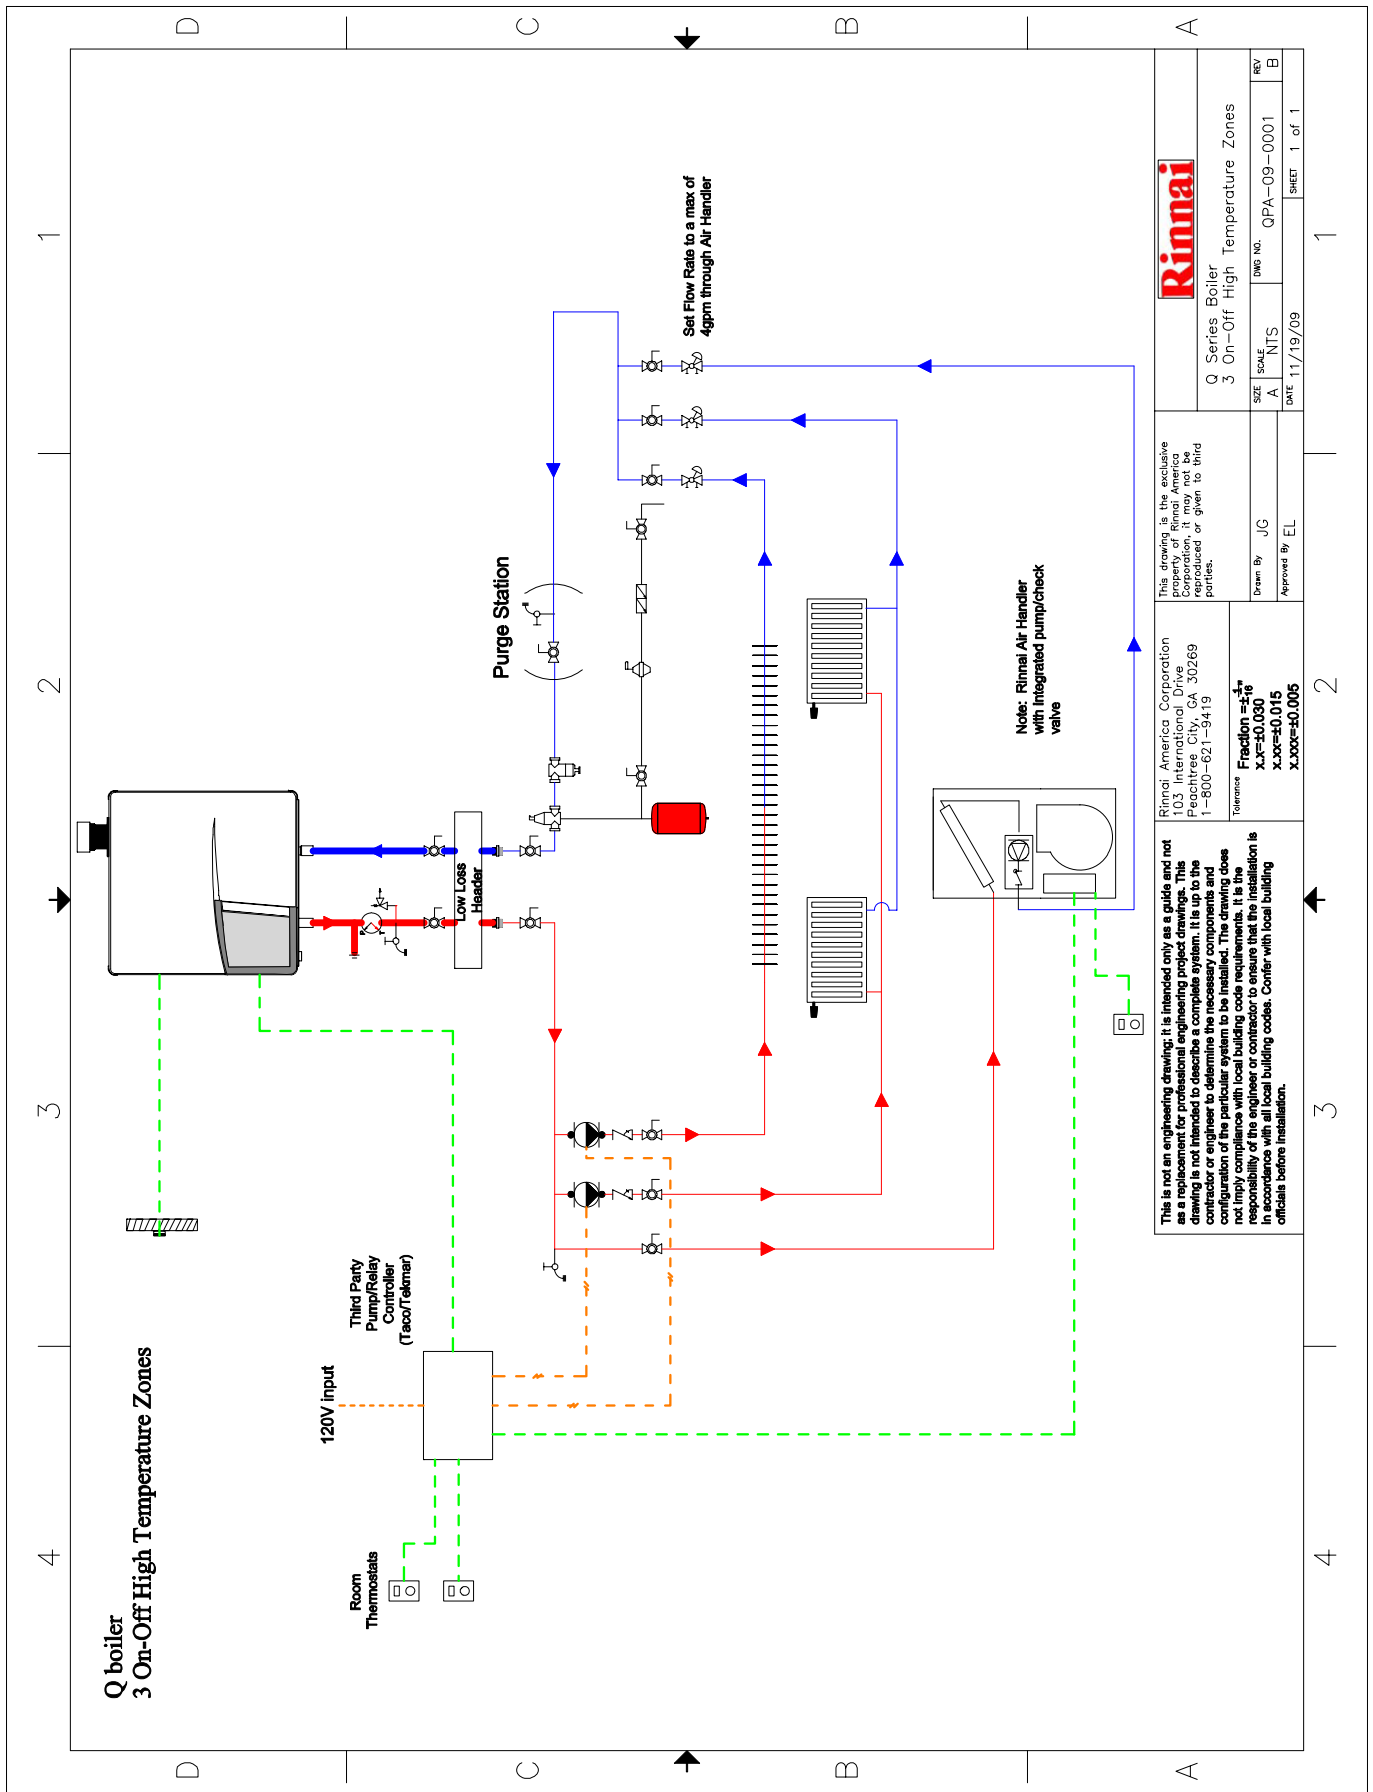

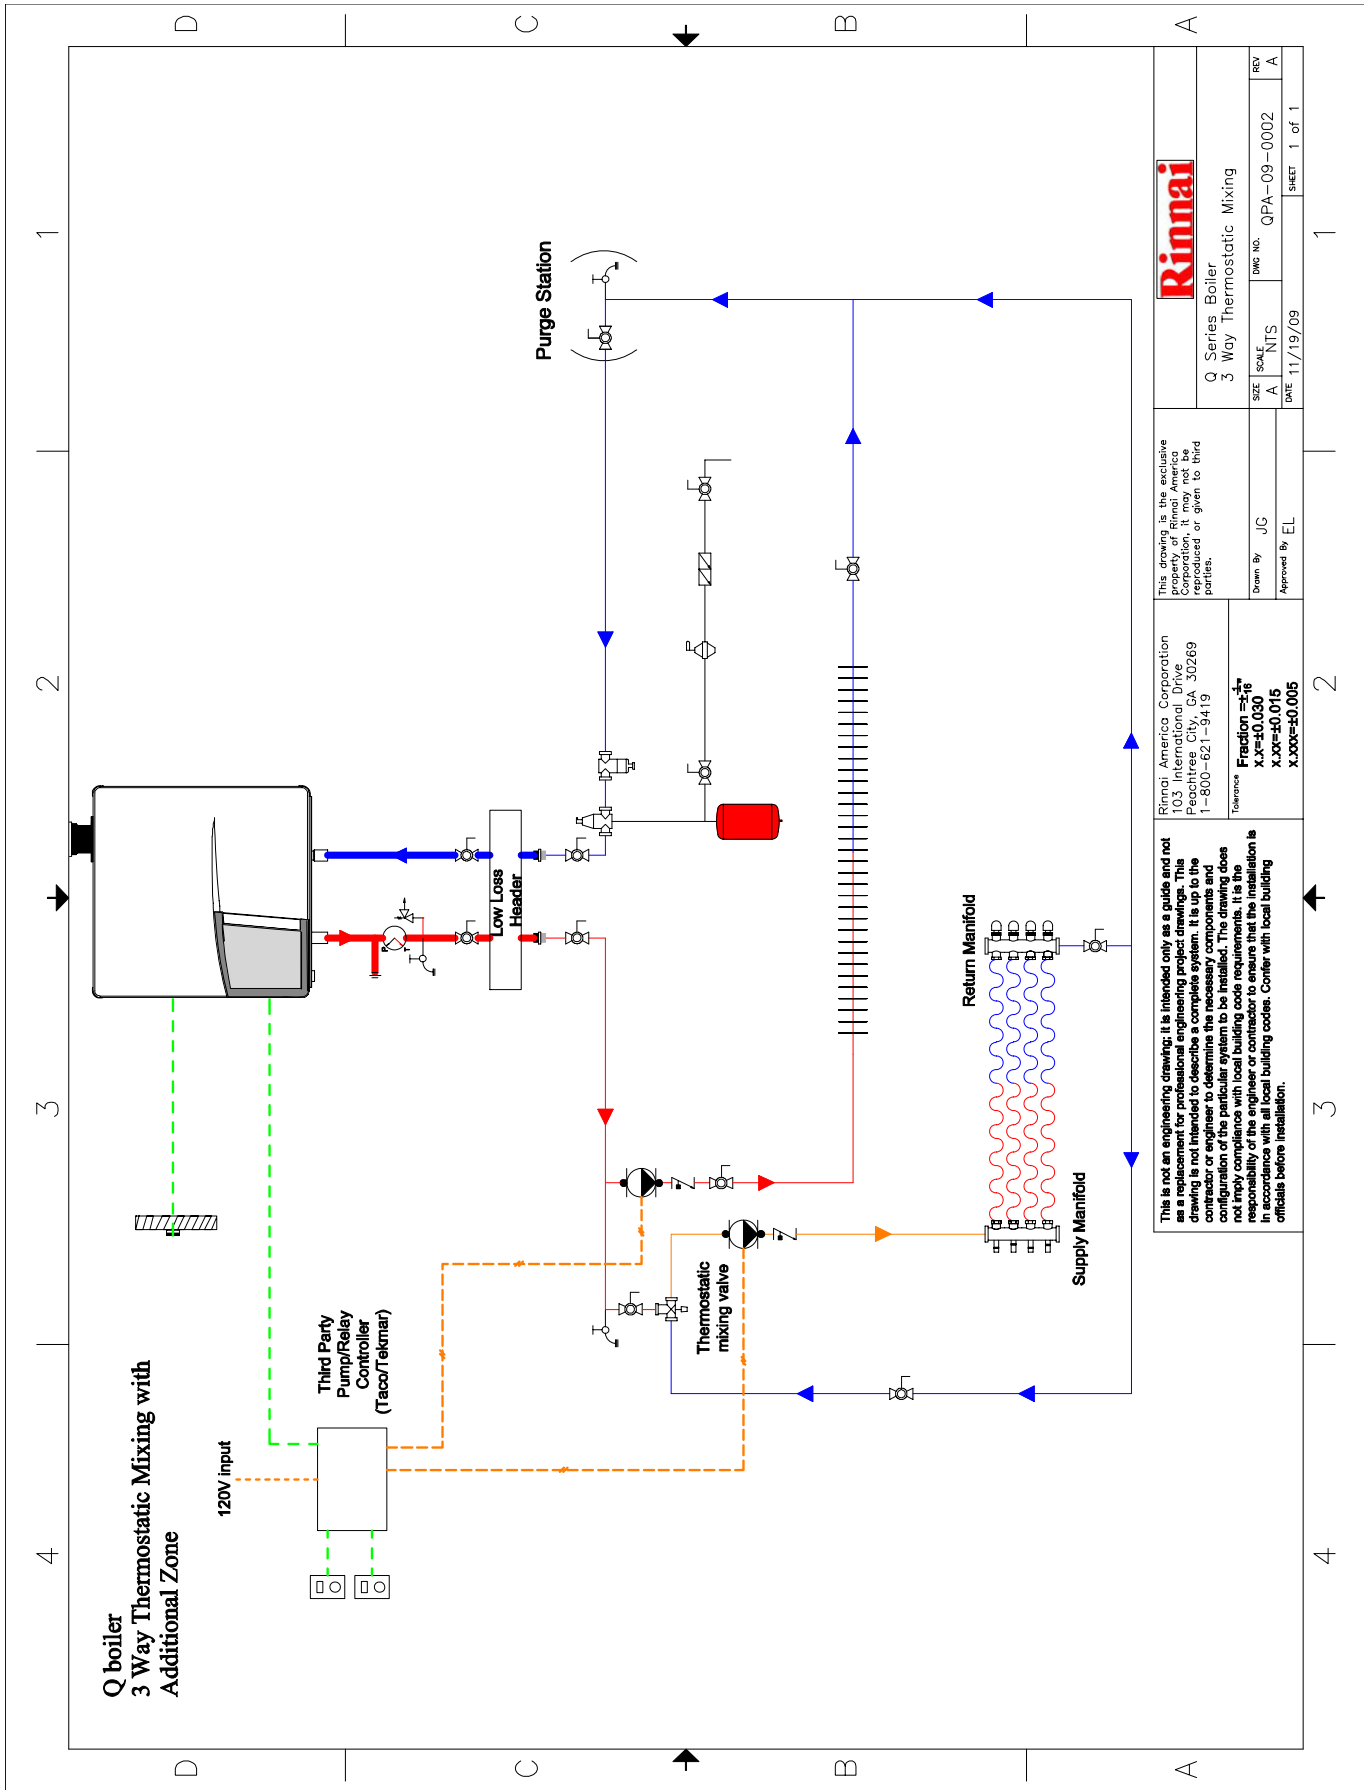

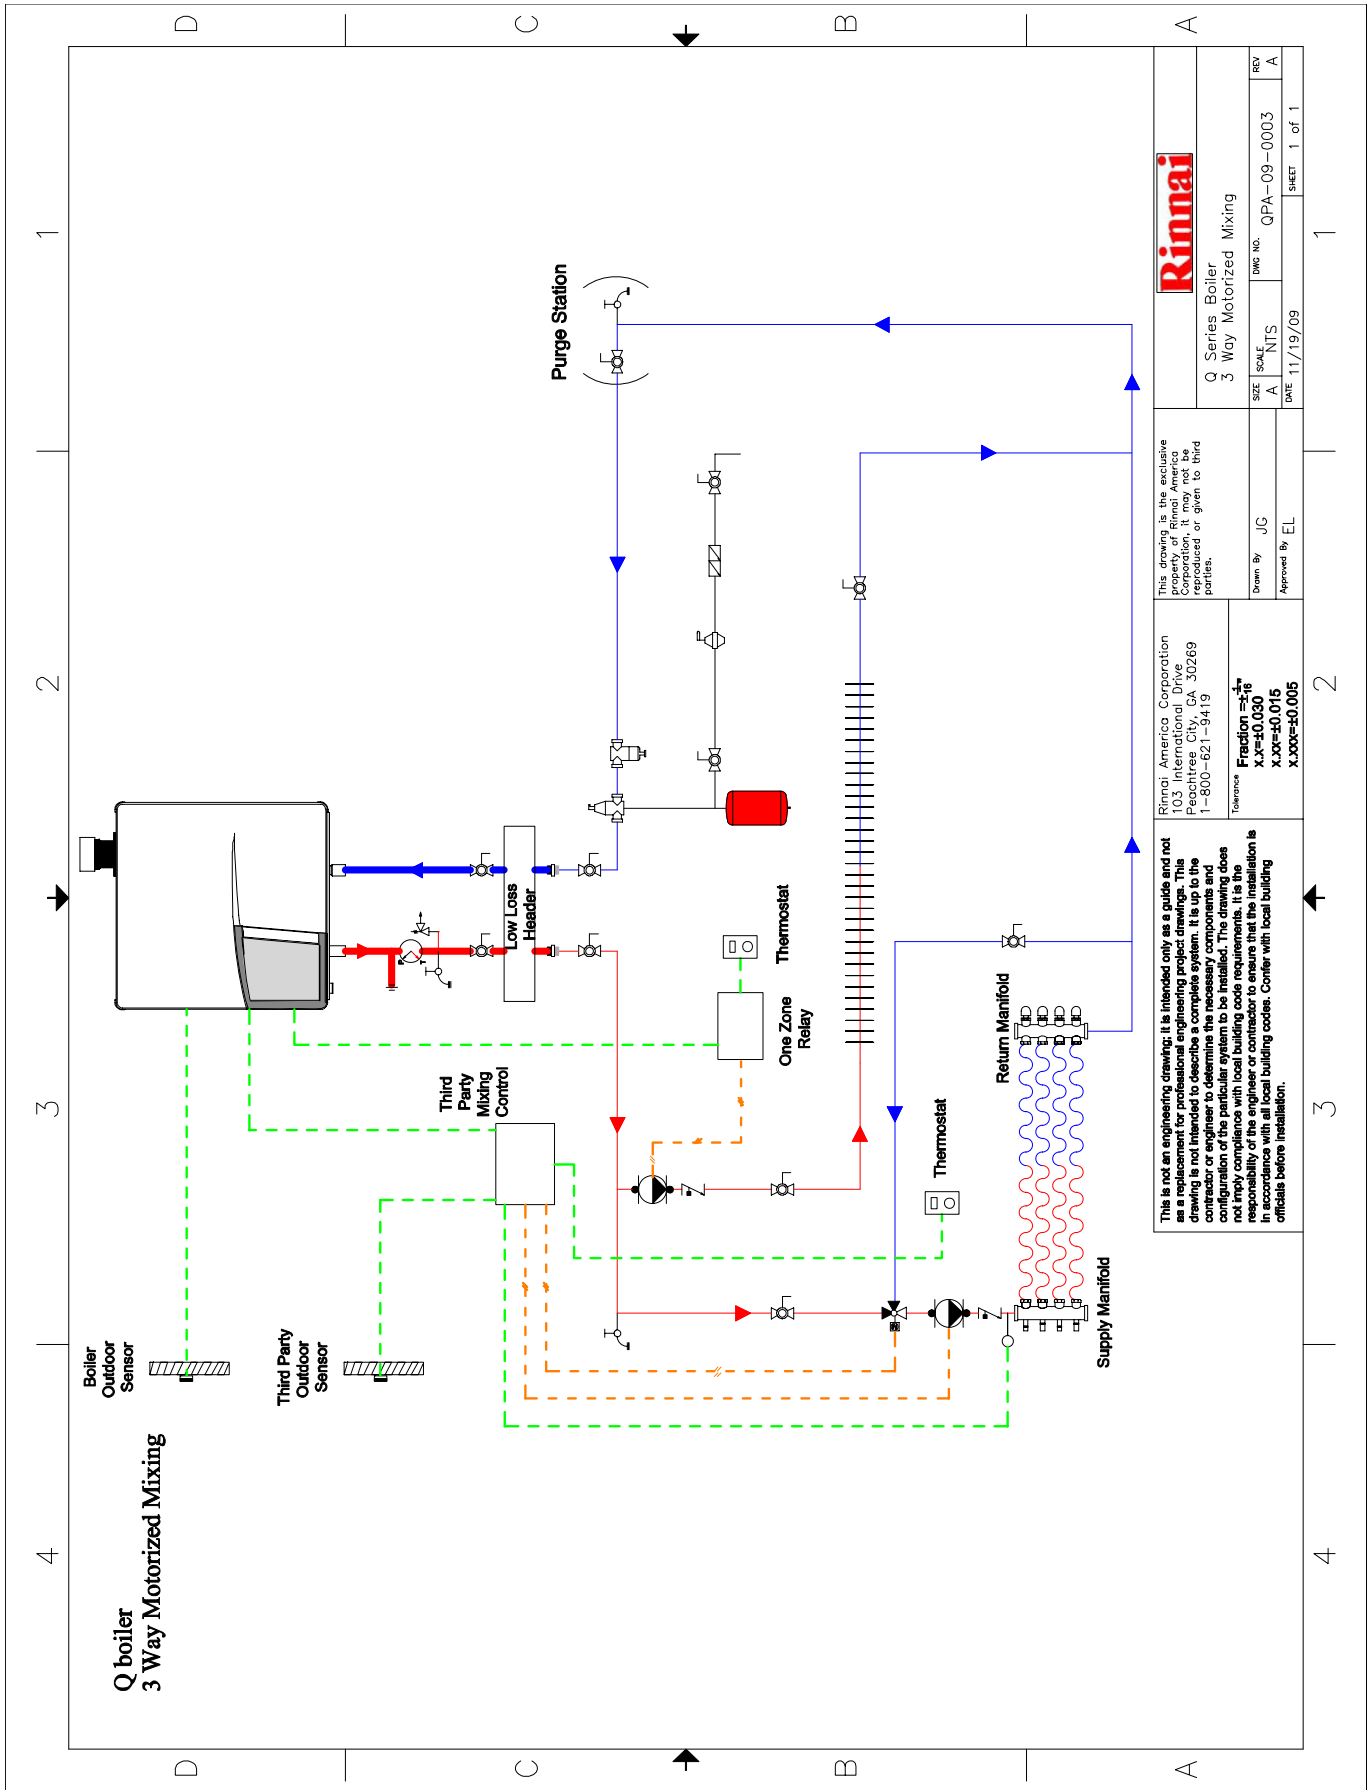

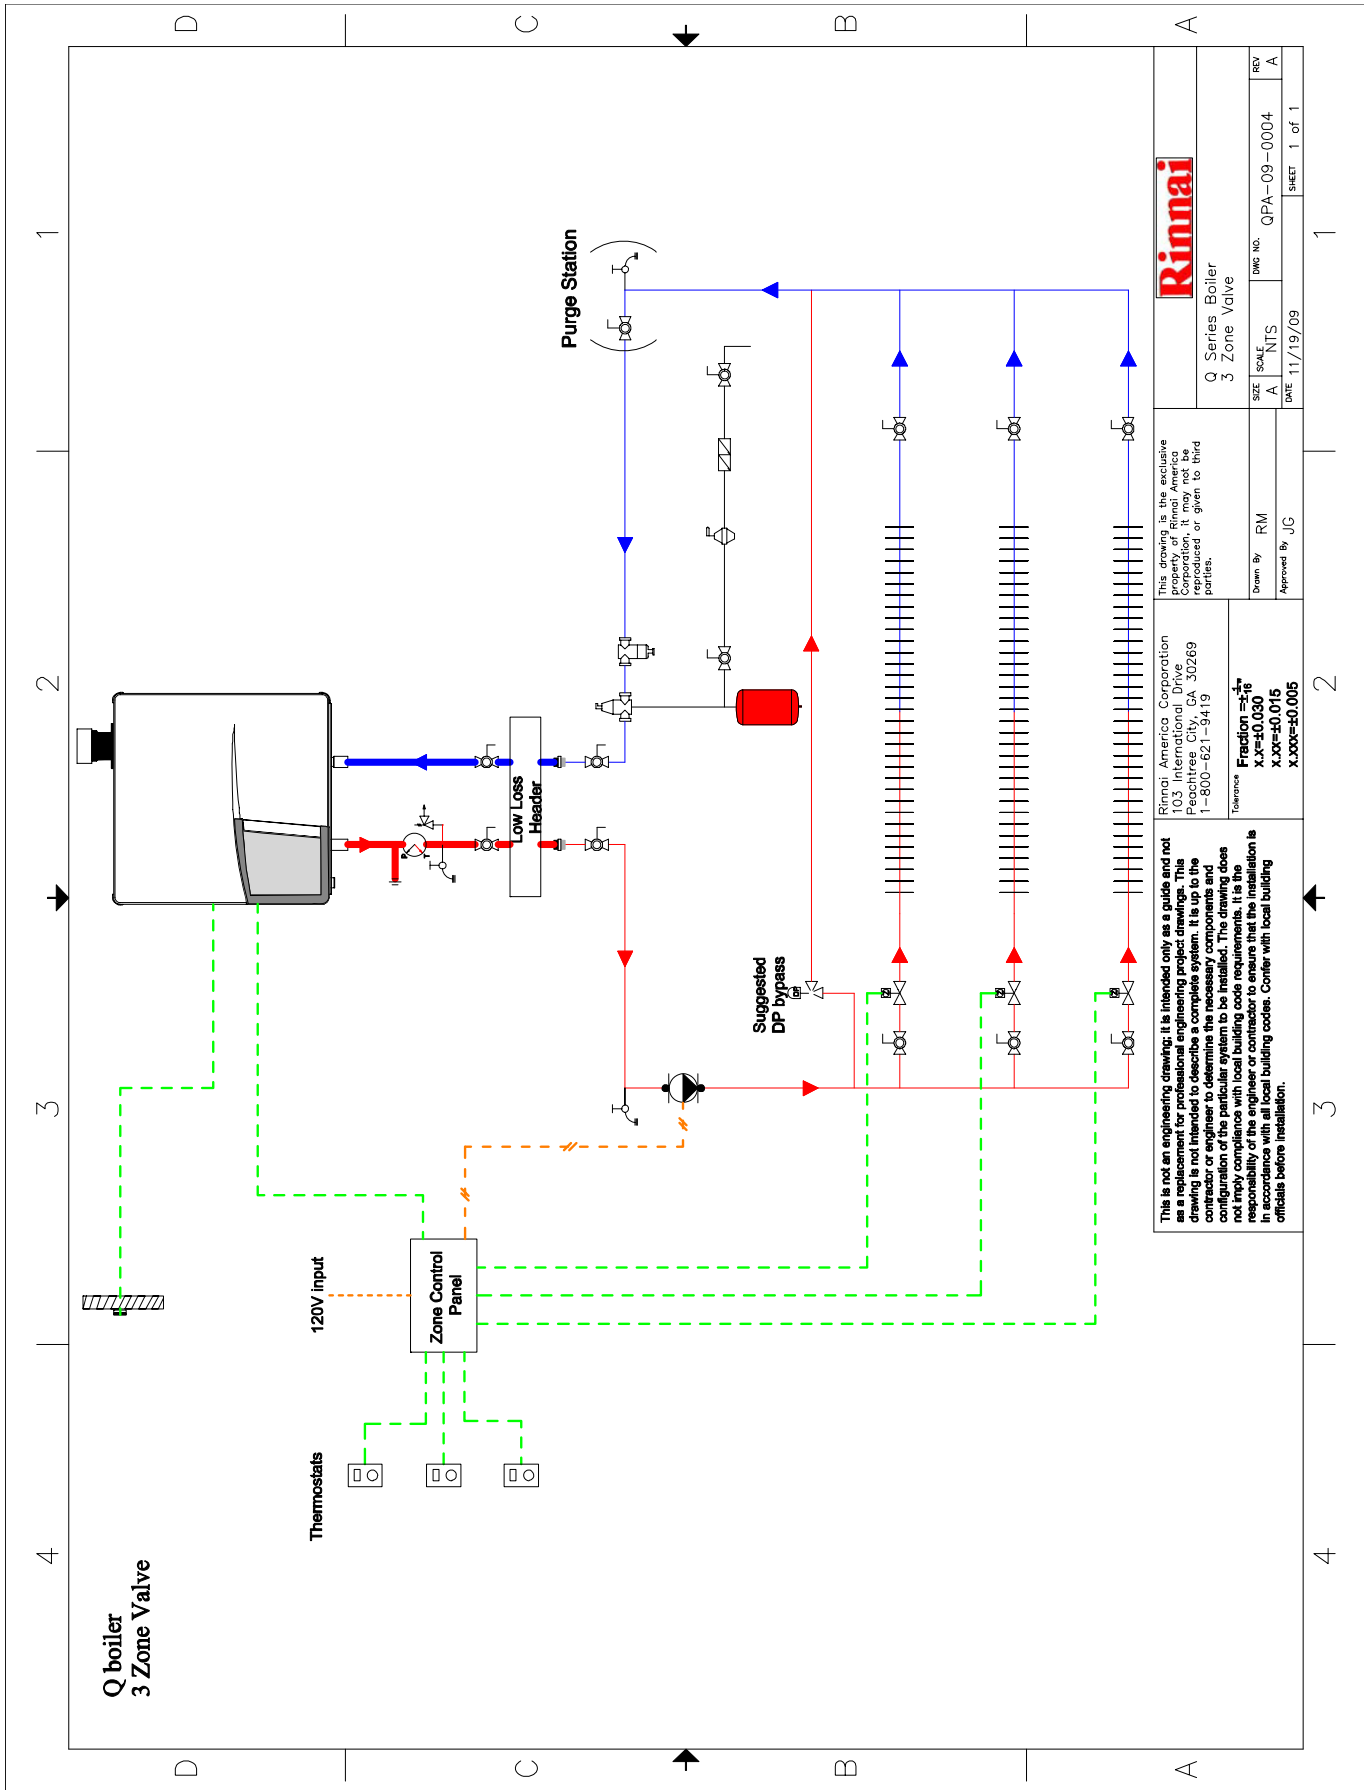

This is not an engineering drawing. It is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

Rinnai

Q Series Boiler
3 Zone Valve

Drawn By: RM
Approved By: JJC

DATE: 11/19/09
SHEET: 1 of 1

This drawing is the exclusive property of Rinnai America Corporation. It may not be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Rinnai America Corporation.


Tolerance

Fraction $\pm \frac{1}{16}$


xx=±0.030


xxx=±0.015


xxxx=±0.005

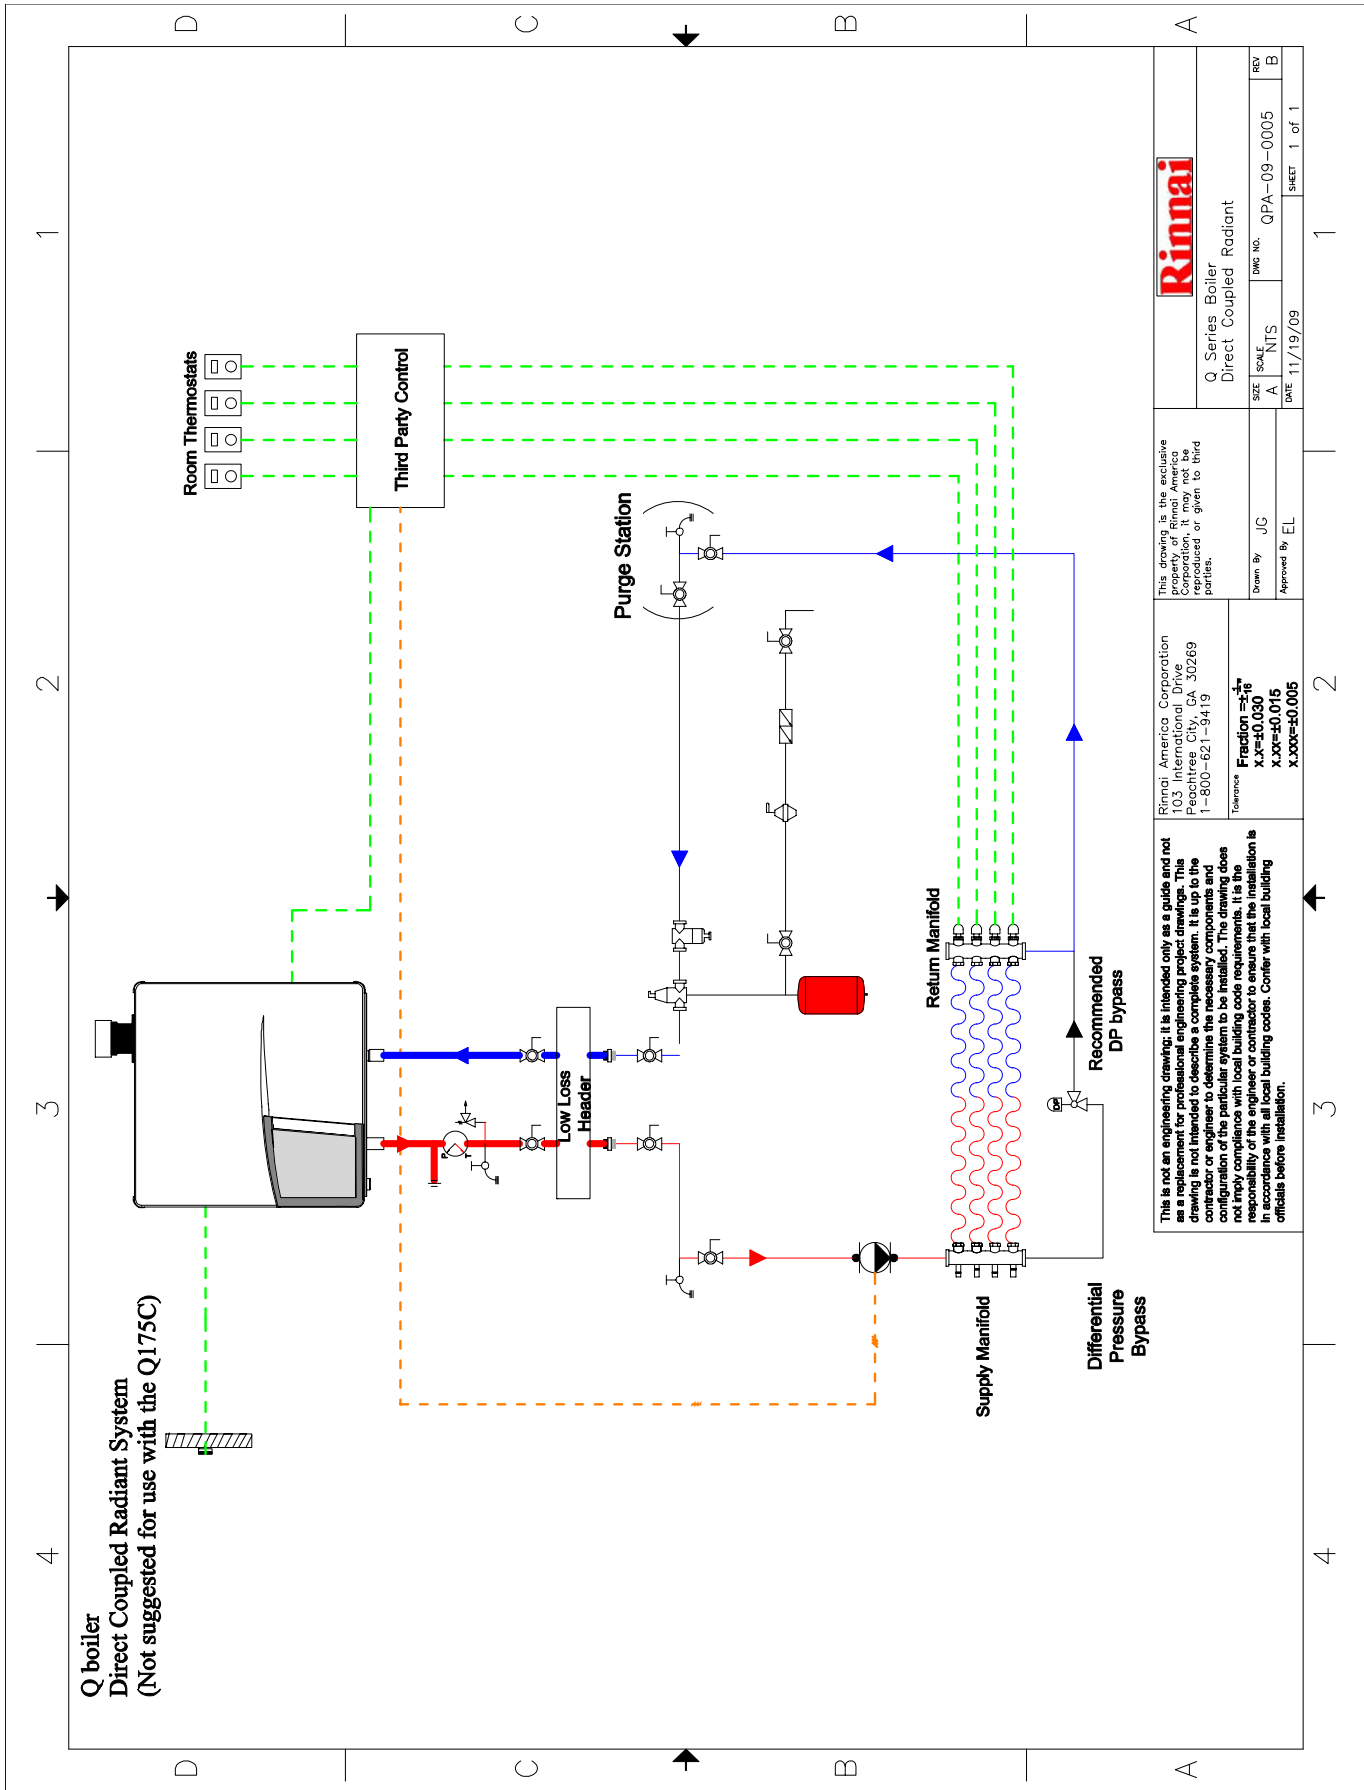


<p>This is not an engineering drawing. It is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.</p>		<p>Rinnai America Corporation 103 International Drive Peachtree City, GA 30269 1-800-621-9419</p>		<p>This drawing is the exclusive property of Rinnai America Corporation. It is not to be reproduced or given to third parties.</p>	
<p>Fraction $\frac{1}{16}$ x.x ± 0.030 x.xx ± 0.015 x.xxx ± 0.005</p>		<p>Drawn By JG Approved By EL</p>		<p>Rinnai Q Series Boiler Direct Coupled Radiant</p>	
<p>DATE 11/19/09</p>		<p>SIZE SCALE A NTS</p>		<p>DWG NO. QPA-09-0005</p>	
<p>SHEET 1 of 1</p>		<p>REV B</p>		<p>1</p>	

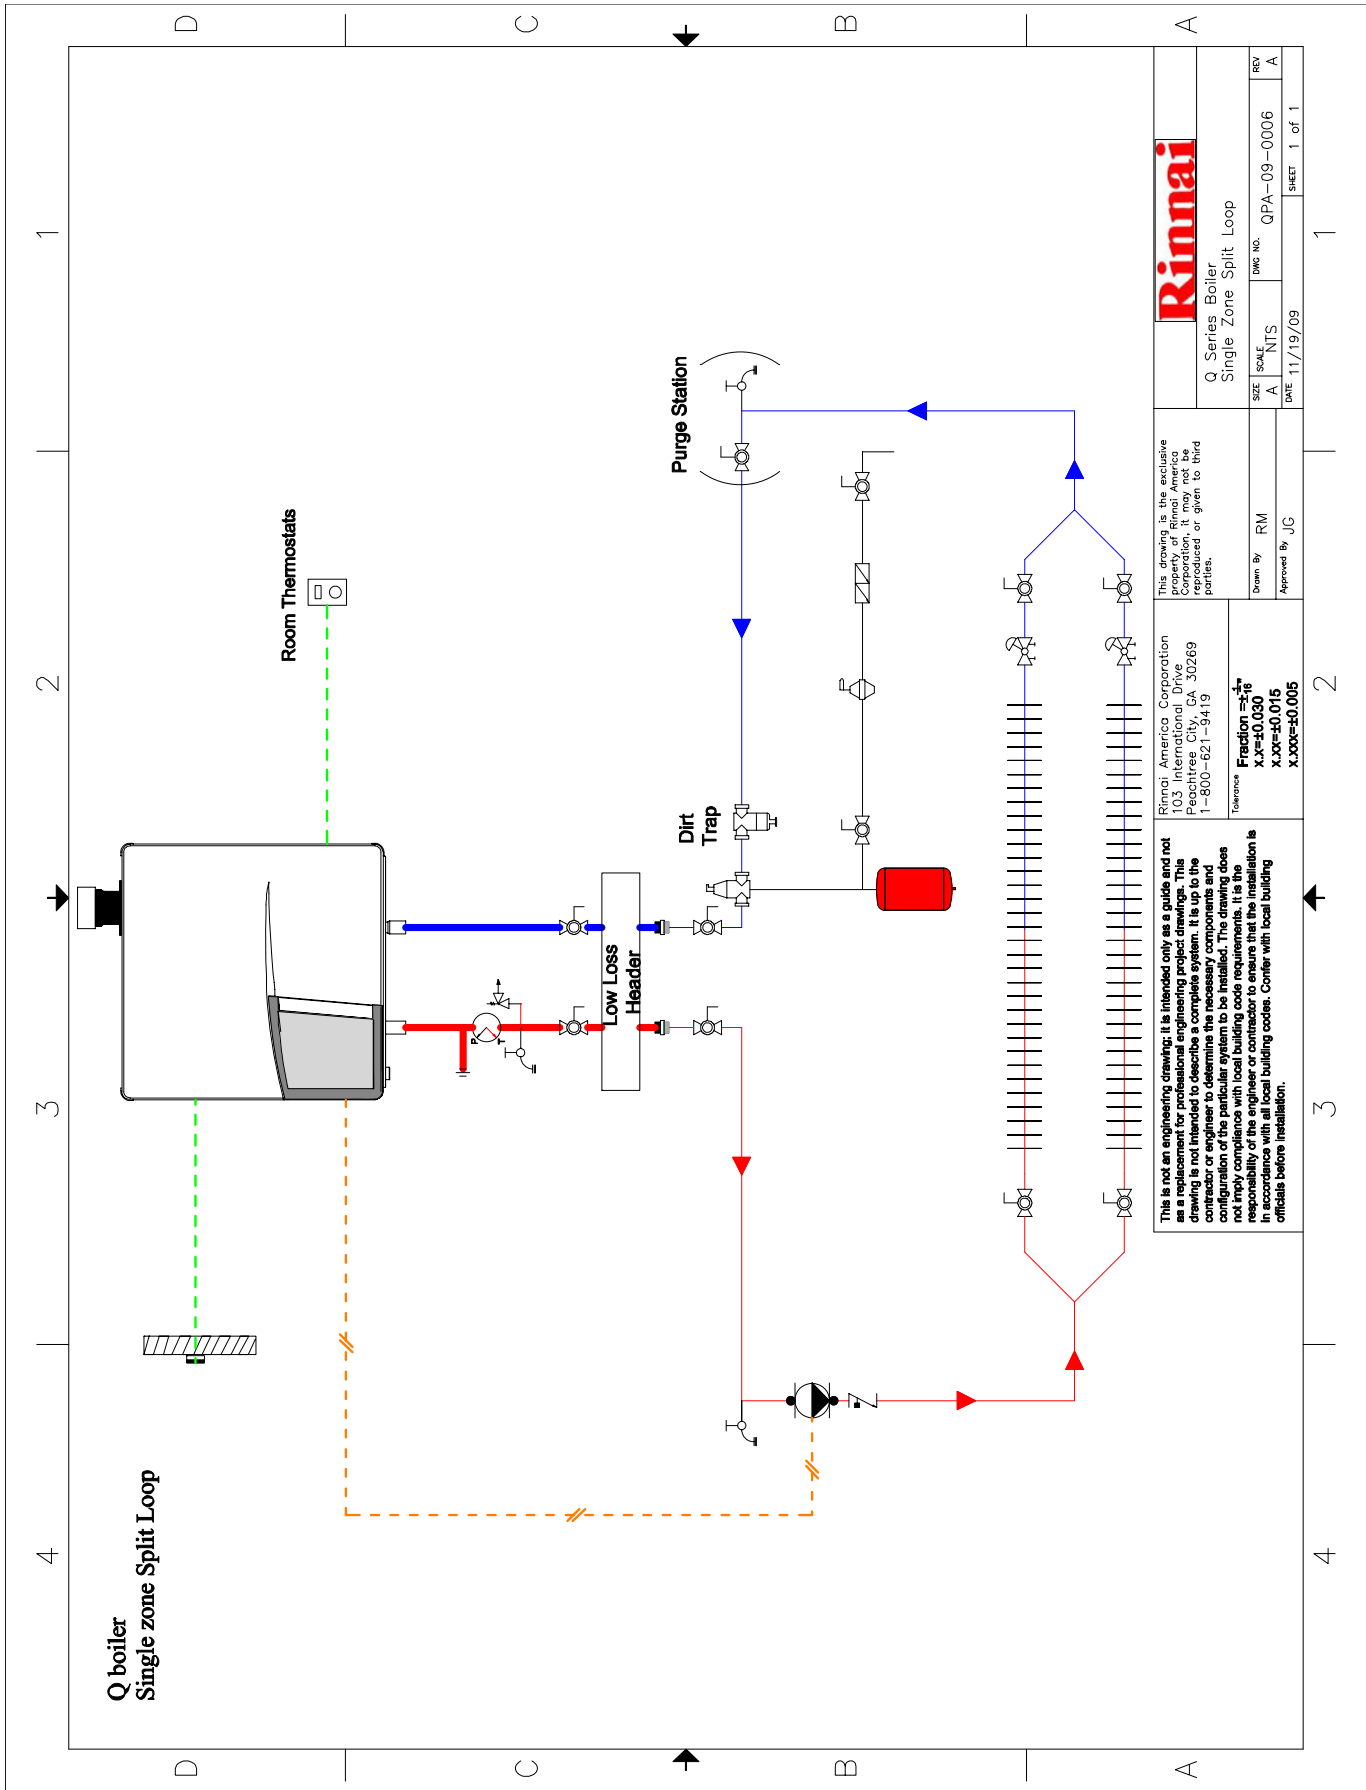

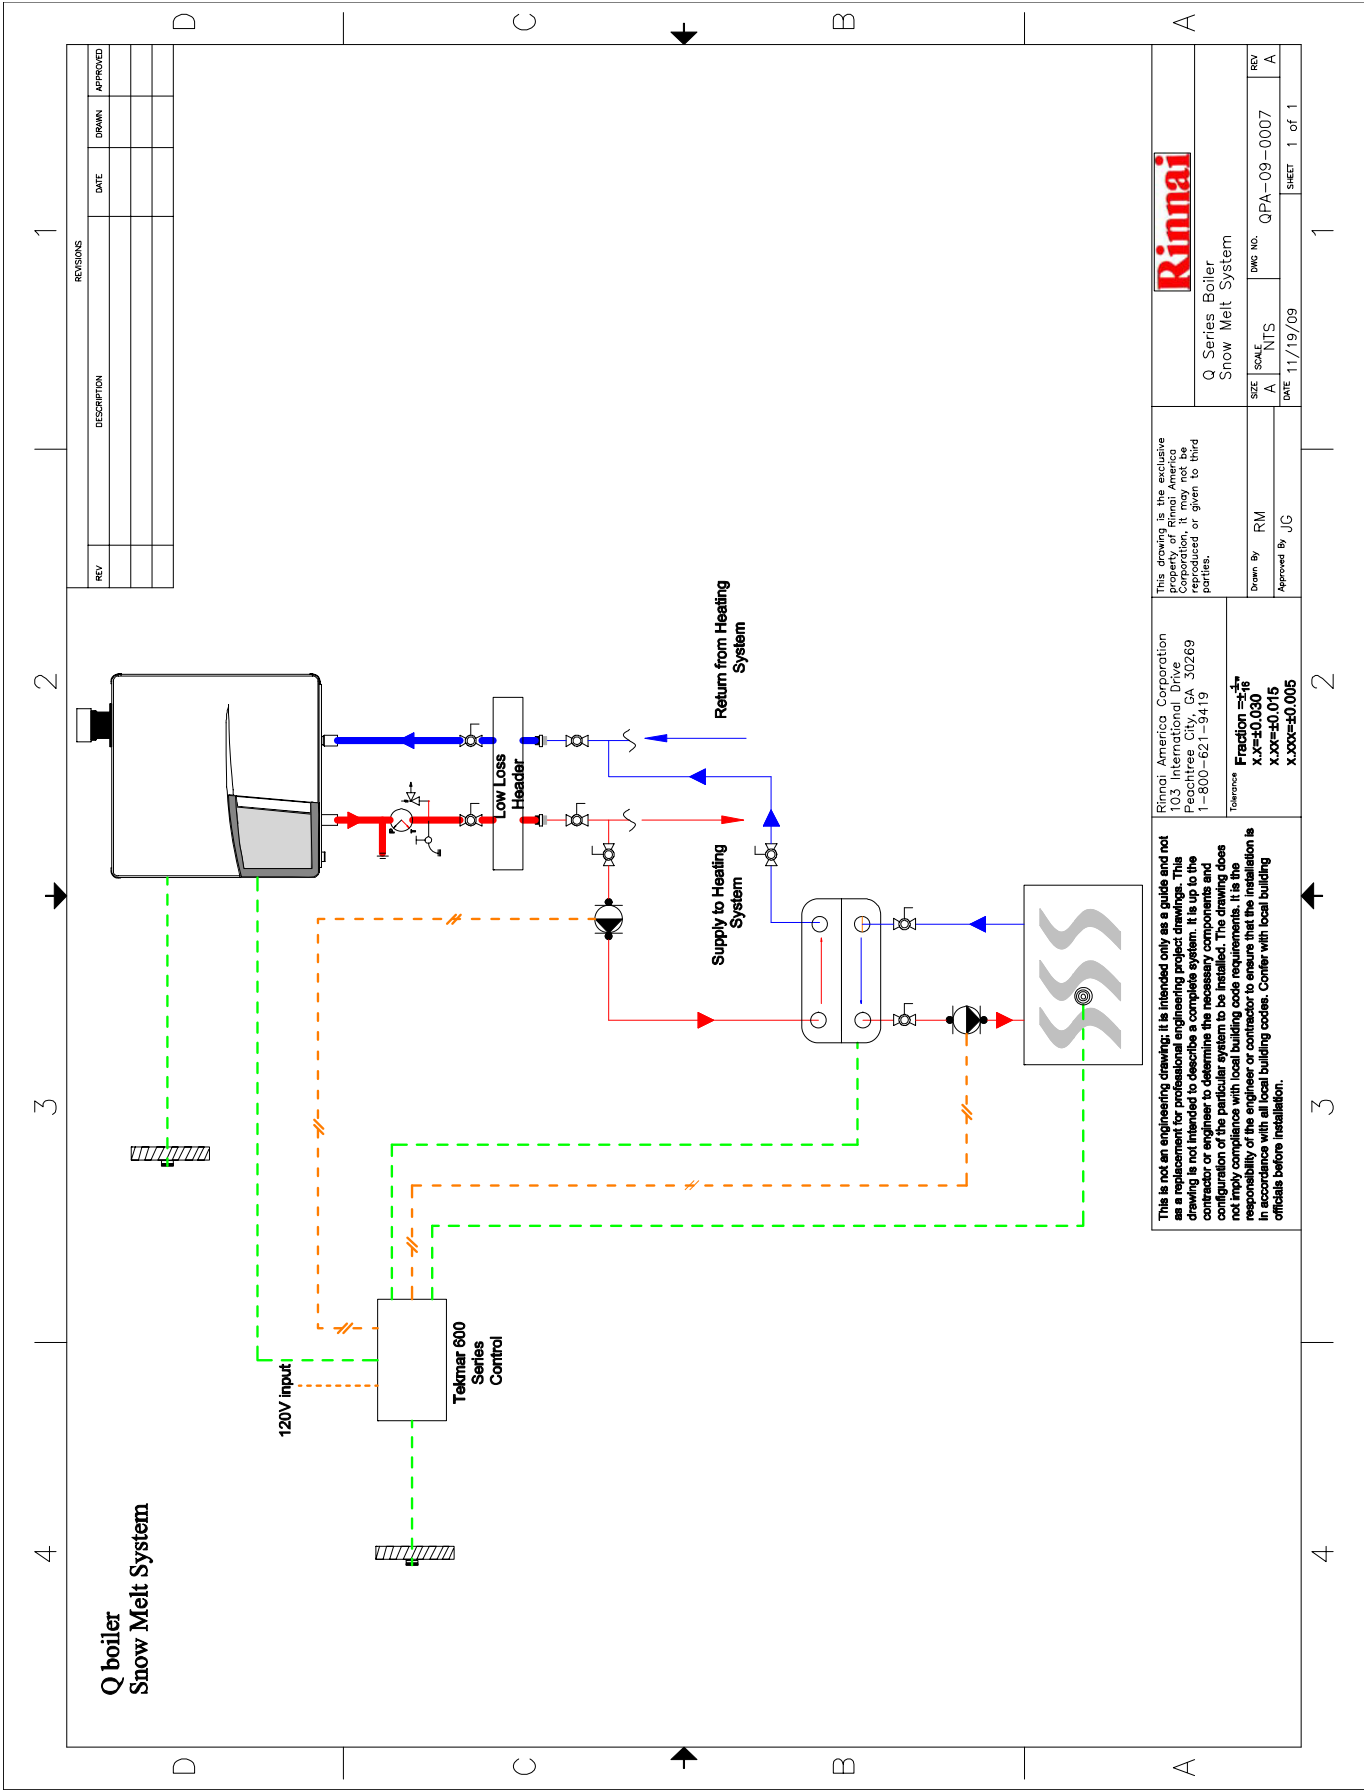

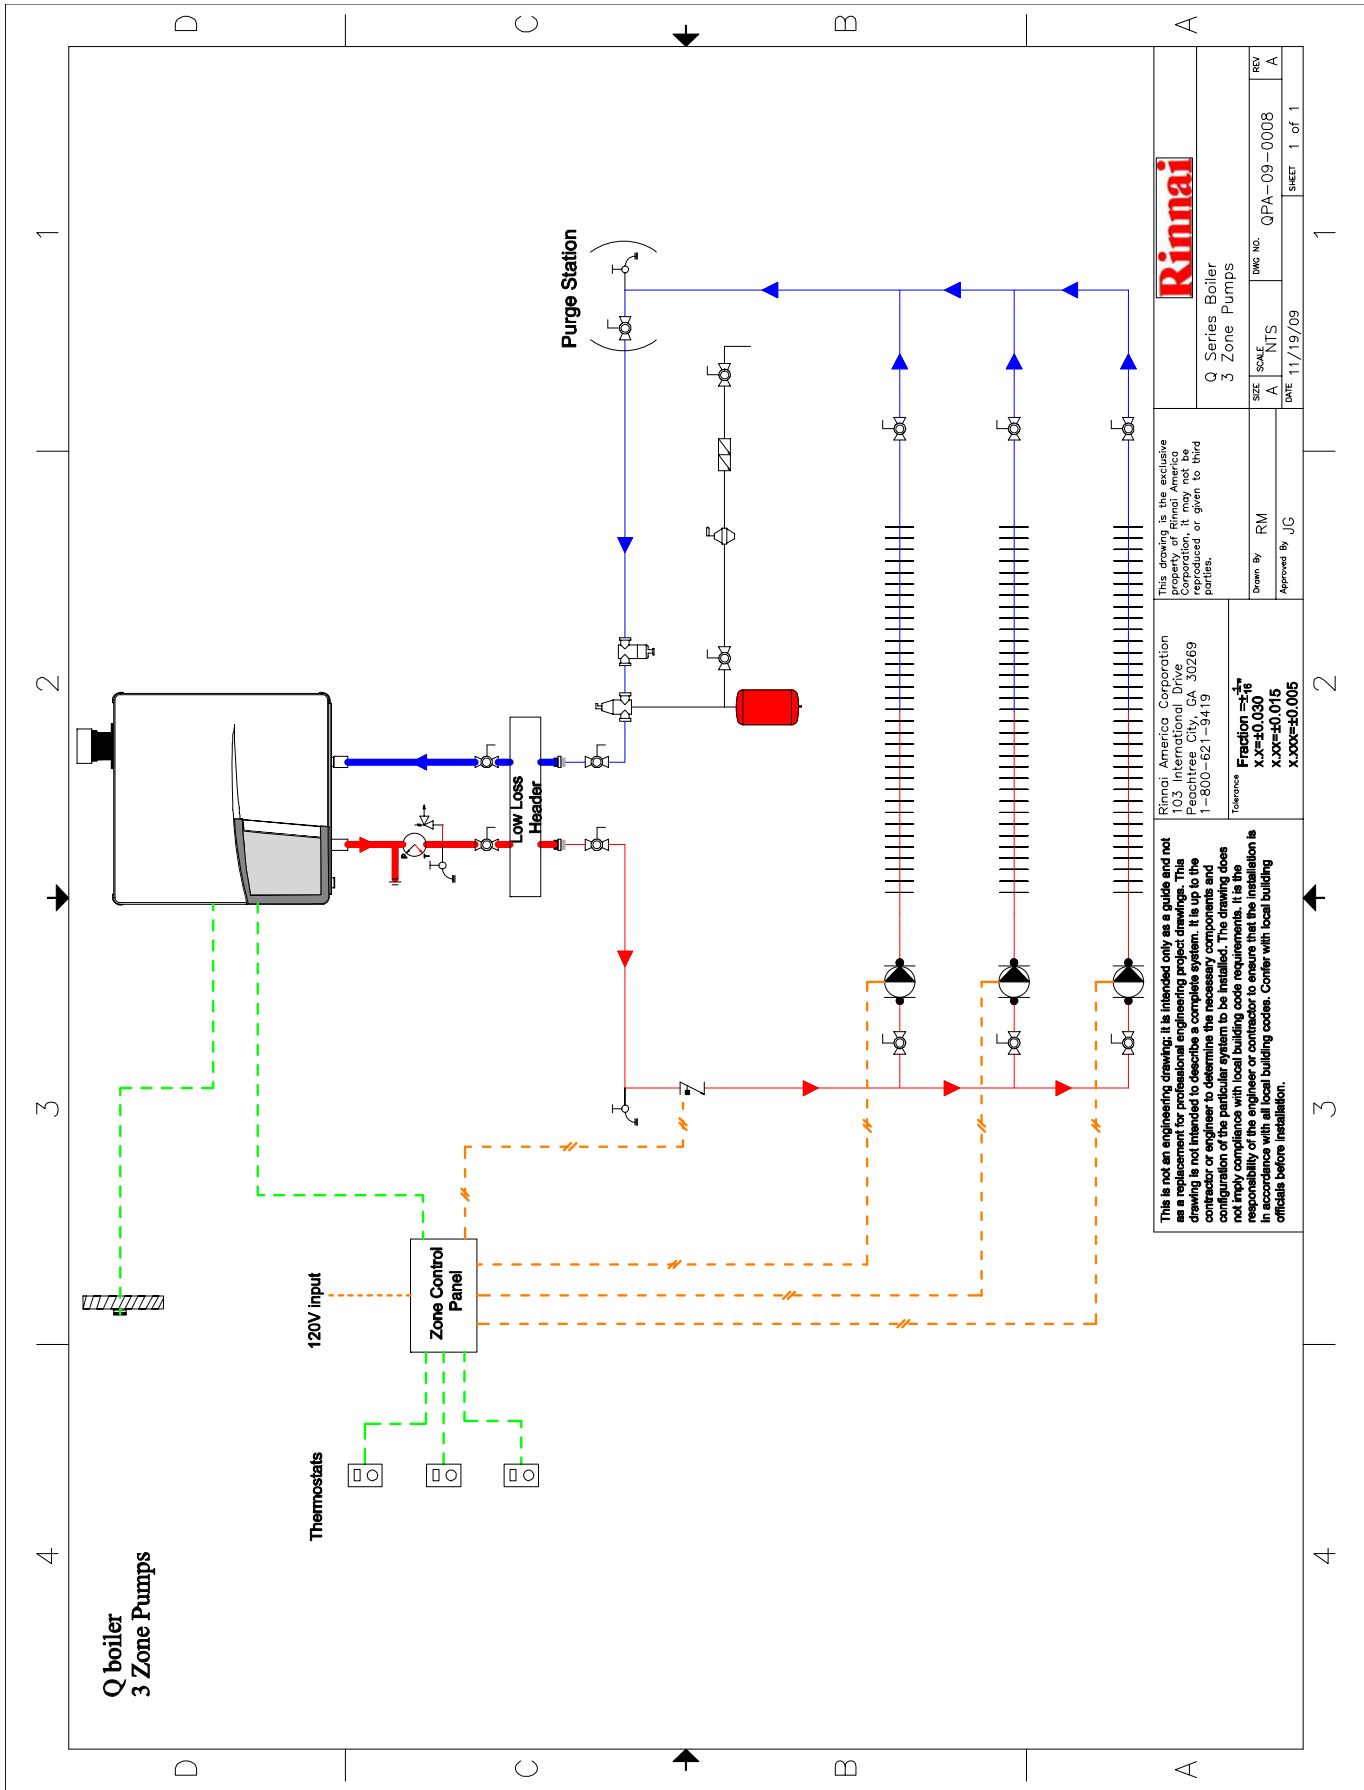

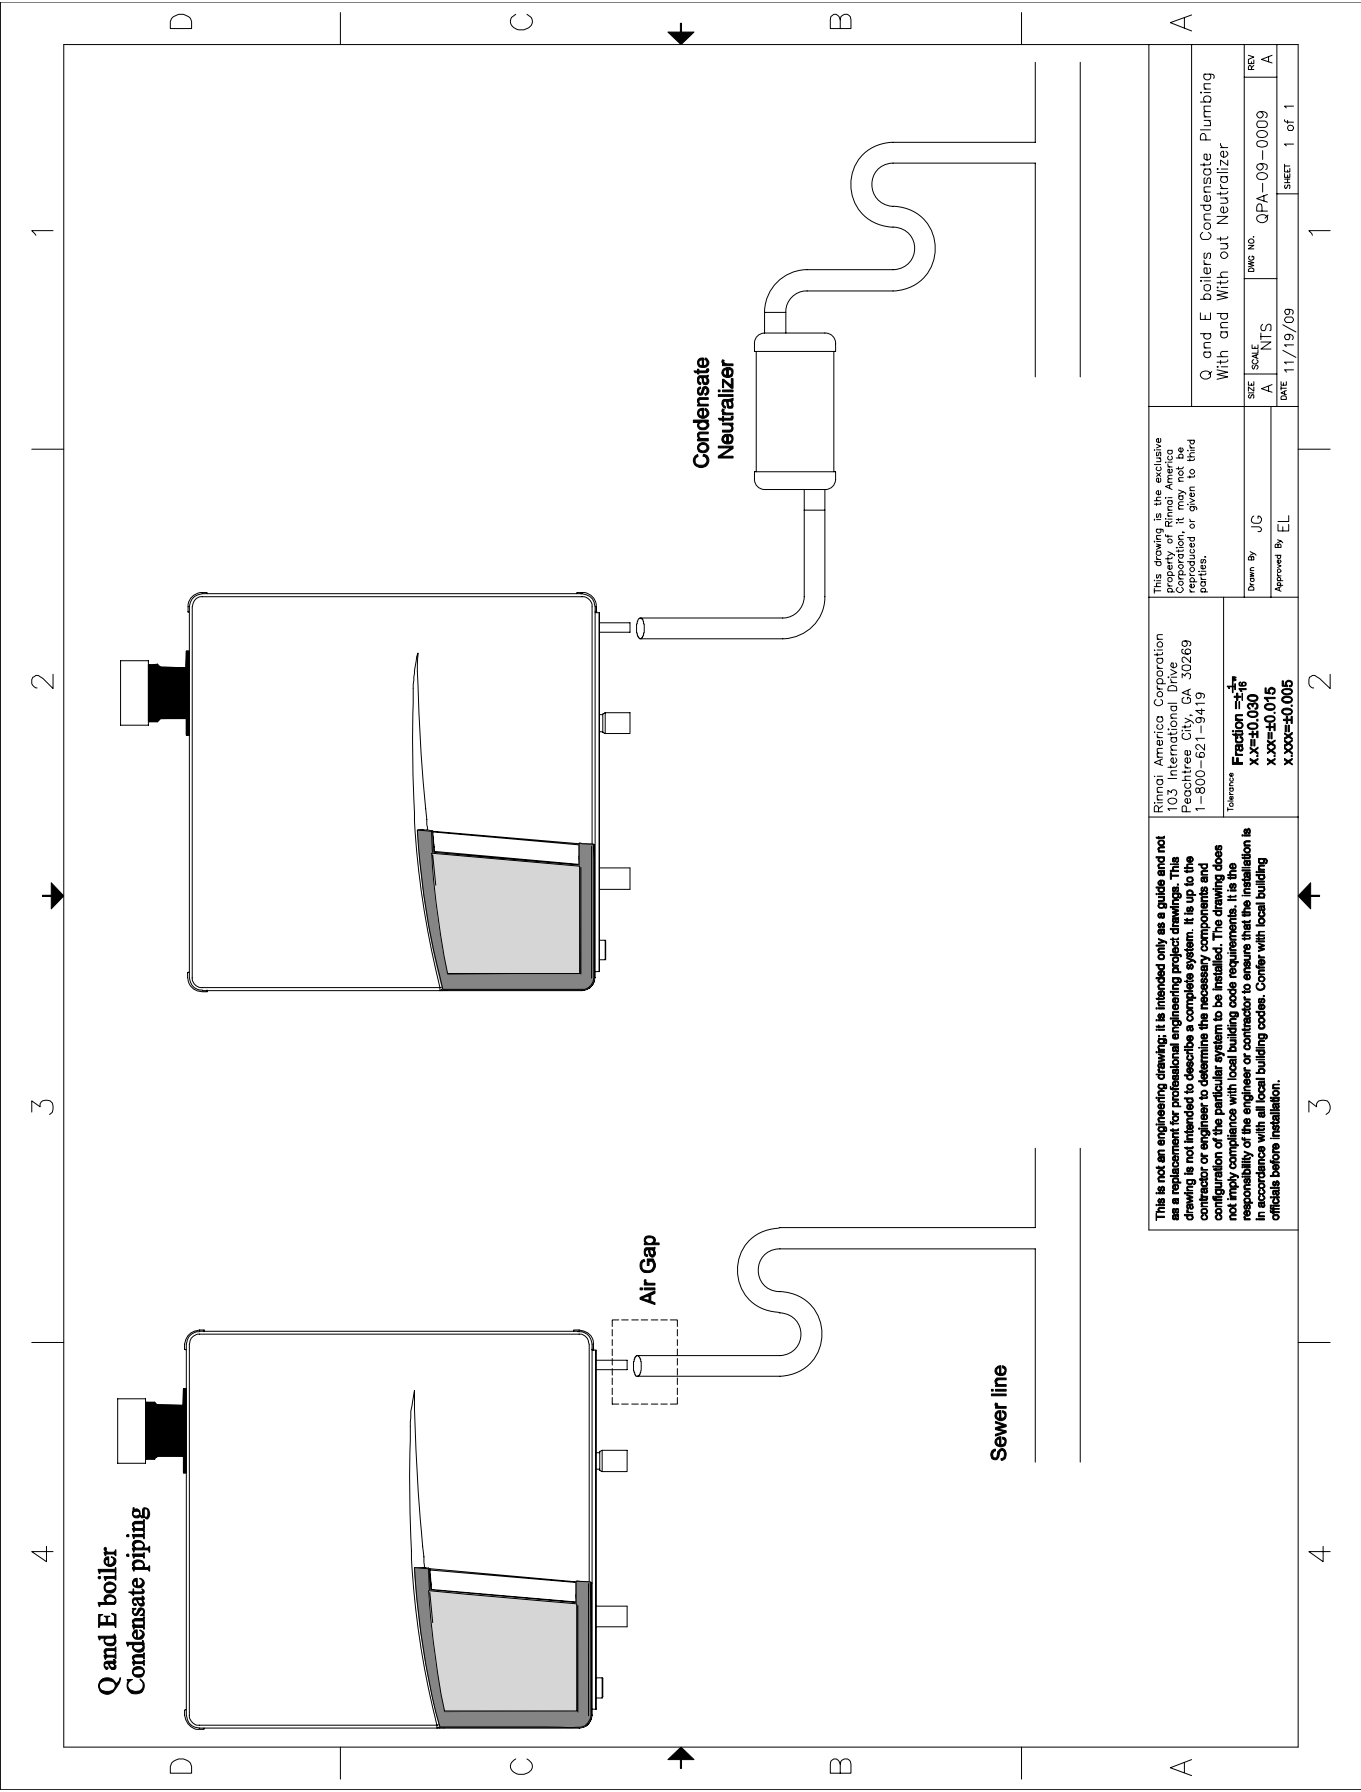

This is not an engineering drawing. It is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

Rinnai America Corporation
103 International Drive
Peachtree City, GA 30269
1-800-621-9419


Tolerance
Fraction $\pm \frac{1}{16}$
X.XX ± 0.030
X.XX ± 0.015
X.XXX ± 0.005


This drawing is the exclusive property of Rinnai America Corporation. It may not be reproduced or given to third parties.

Drawn By JG
Approved By EL

Q and E boilers Condensate Plumbing
With and With out Neutralizer

SIZE A
SCALE NTS
DATE 11/19/09
DWG NO. QPA-09-0009
REV A
SHEET 1 of 1

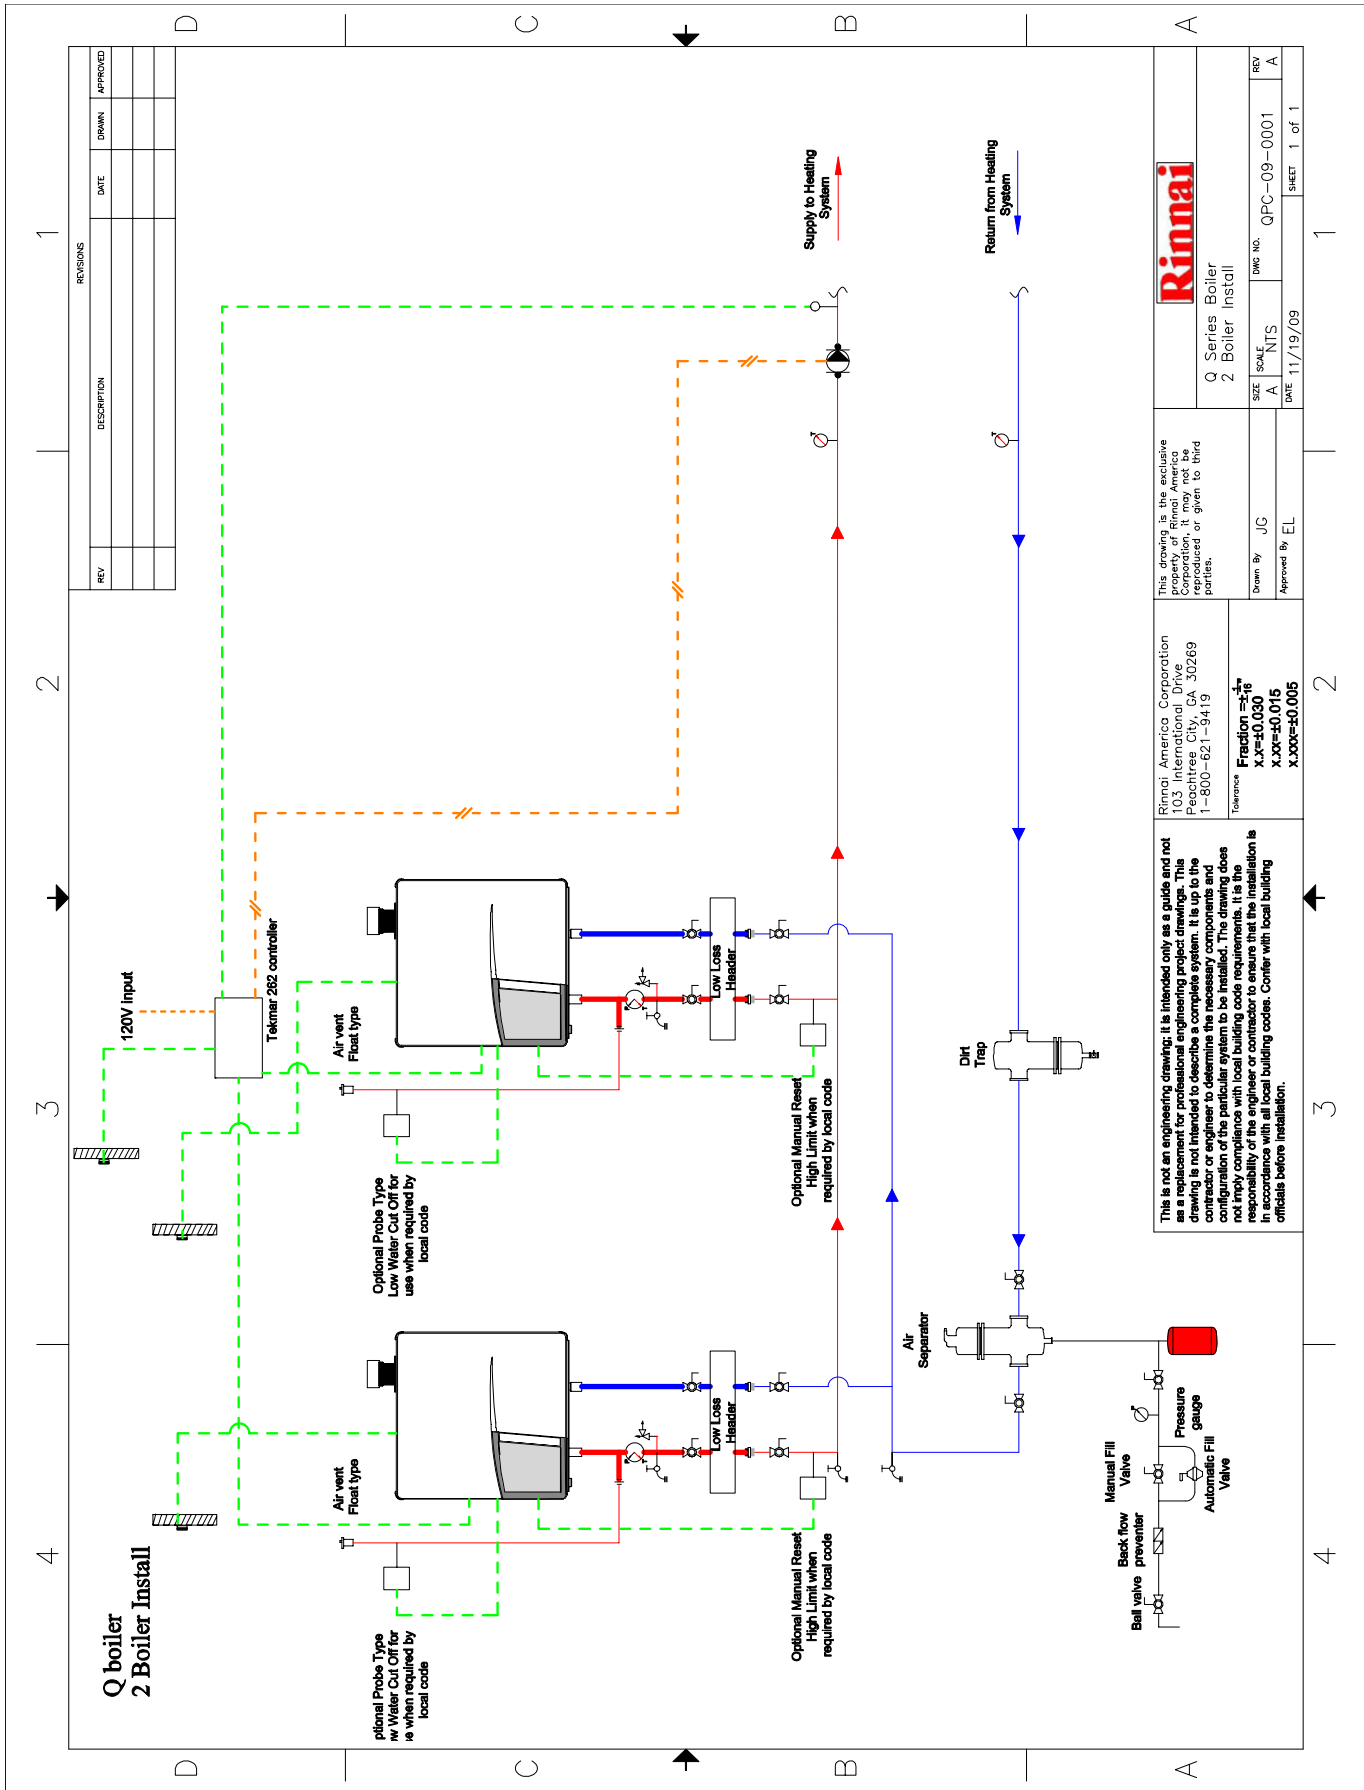

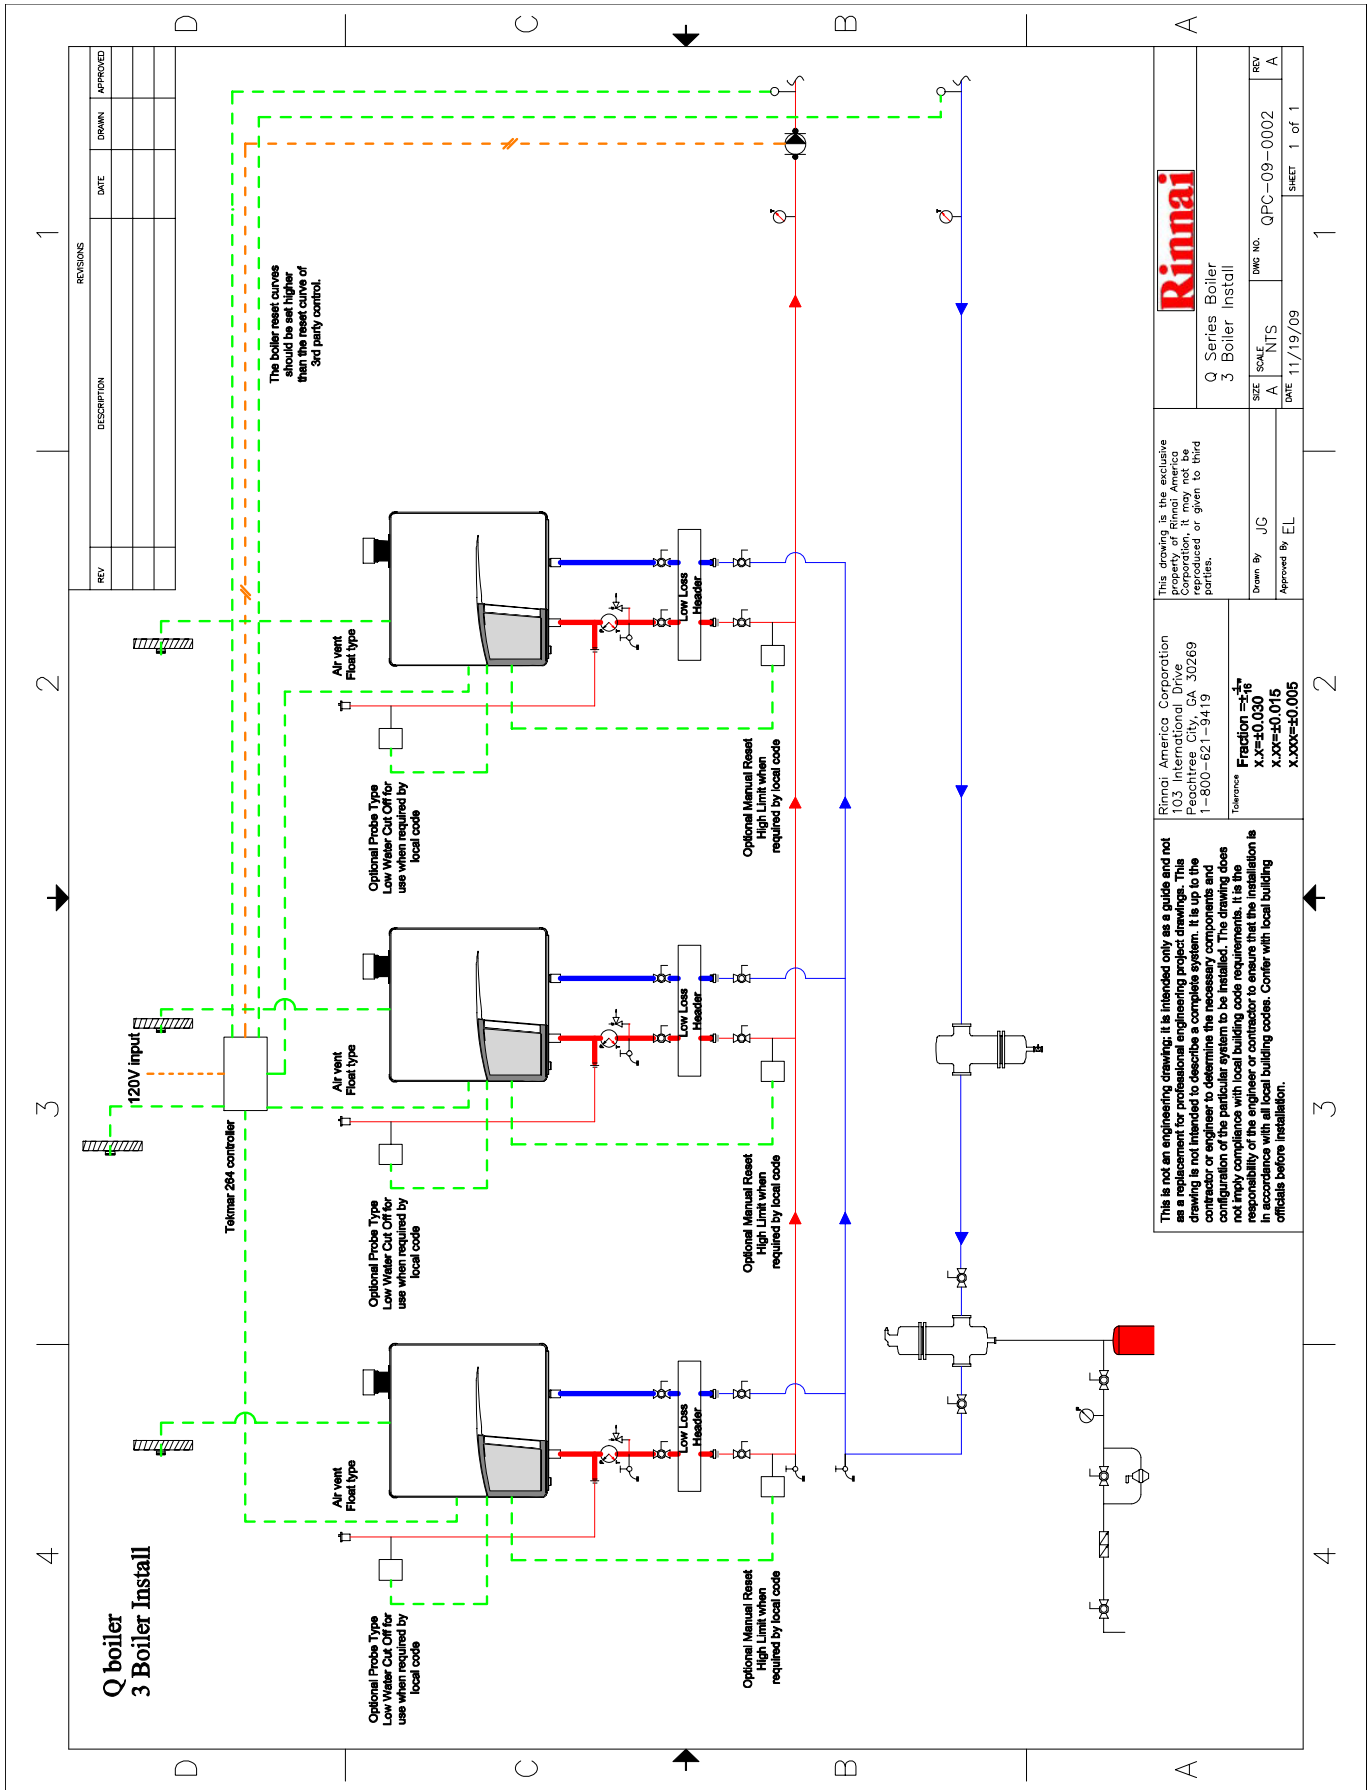

Notes

— Ask about — Rinnai®

Rinnai's other fine products

EXPERIENCE OUR INNOVATION™



Tankless Water Heaters

- Residential and Commercial Applications
- Continuous Hot Water
- ENERGY STAR® qualified models
- Up to 9.8 GPM
- Internal or External Installation
- Digital Temperature Control



Direct Vent Furnaces

- High Efficiency
- Cool-to-the-touch Cabinet
- Vent Terminal A Included
- Blower Included



Direct-Vent Fireplace, RHFE-750ETRA

- Up to 83% AFUE Energy Efficiency
- Zero-Clearance Installation
- Available in Four Options of Fronts
- Remotes and Fan Included
- Gas Conversion Kit Available



Hydronic Air Handler

- Designed for Use with Rinnai Systems
- Domestic Hot Water Priority
- Optional Programmable Thermostat
- Zero Clearance to Combustibles
- Accommodates Standard Cased-Coils



Boilers

- Residential and Commercial Applications
- ENERGY STAR® qualified models
- Up to 96.5% AFUE efficiency
- Compact wall mounted design
- ASME accredited models



Condensing Tankless Water Heaters

- Residential and Commercial Applications
- ENERGY STAR® qualified models
- Up to 95% thermal efficiency
- Internal or External Installation
- Pair up with the Rinnai Air Handler for efficient home heating



Rinnai Impression - Outdoor Fireplace

- Options include one-sided open, two-sided open, and freestanding.
- No electrical requirements
- Propane or convertible to natural gas with conversion kit provided
- Modular construction offers design flexibility

Register your product at
www.rinnairegistration.com
or call 1-866-RINNAI1 (746-6241)

For information on Rinnai's products contact
Rinnai America Corporation
103 International Drive
Peachtree City, GA 30269
TOLL FREE: 1-800-621-9419
FAX: 678-829-1666
www.rinnai.us

Boiler Applications Manual
800000026 Rev A
6/2010